


Special Board Configuration and Wiring Approval.

CEF Branch:	Sales Engineer:	Quote Reference:	Board Reference:	Company:	Approved by:	Date:
Castleford	Chris Kitching	Q-040716	EON-PV-IN	C.E.F	T.B.A	26.06.24

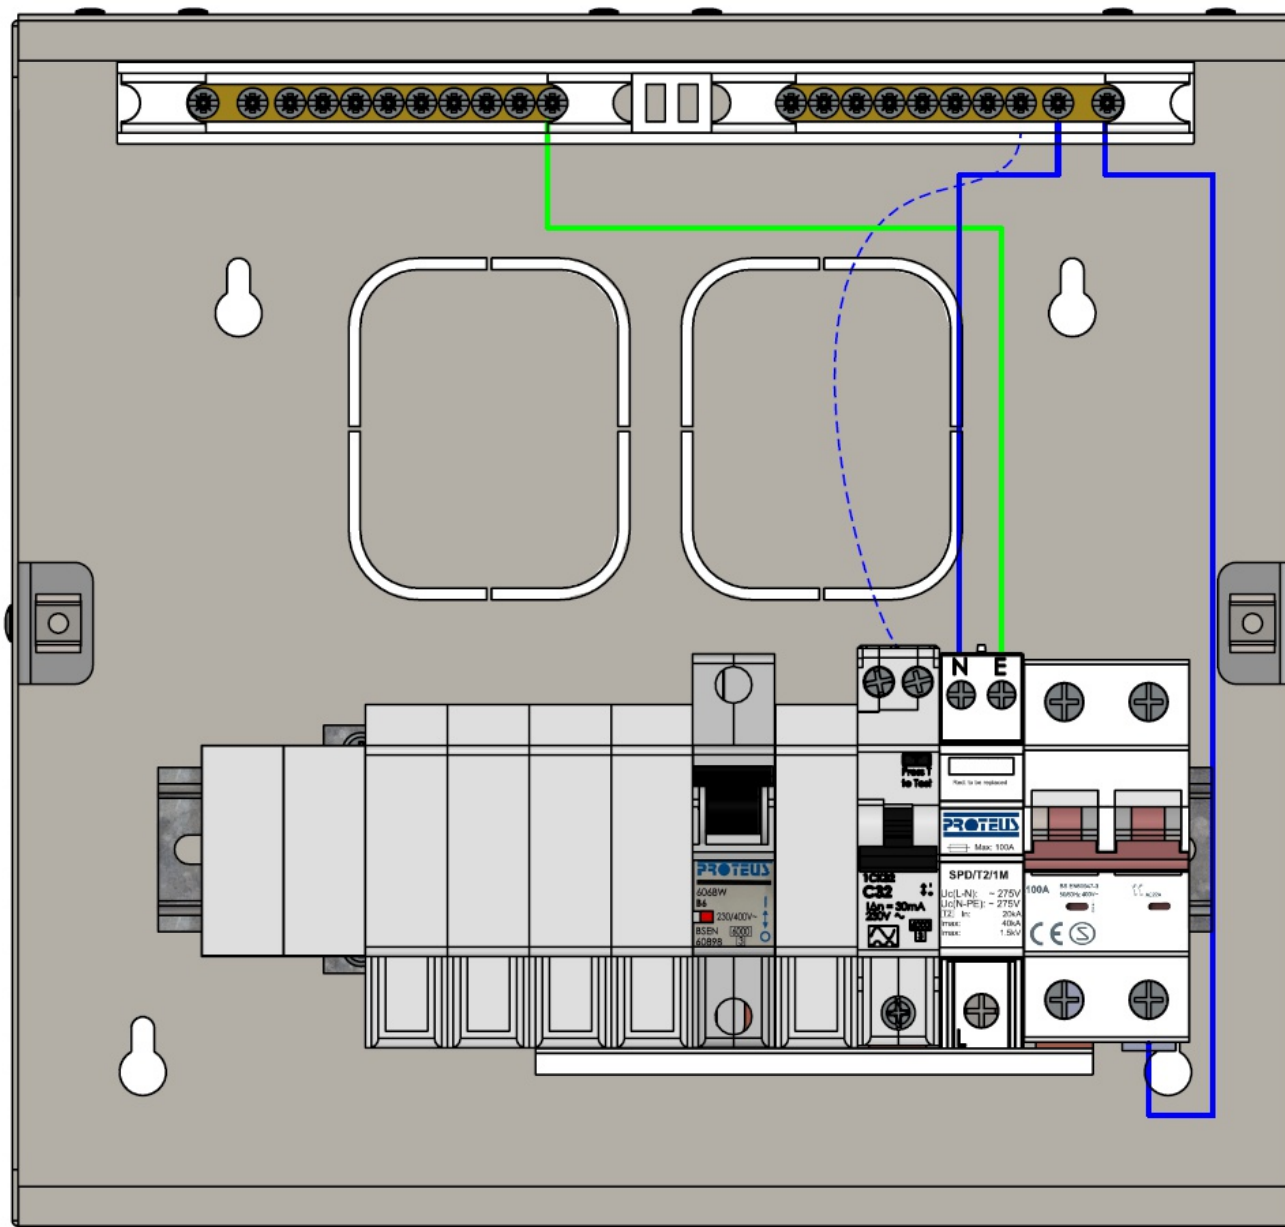

Bill of materials.

Item	Qty.
10 module metalclad unit	1
100 A DP Isolator	1
6 A B curve MCB	1
RCBO 32 A 30 mA C curve	1
Surge device Single mod type 2	1
Blank module (BM1)	5
Blank plate (B1)	2

Dimensions.

Width: 309 mm
Height: 256 mm
Depth: 110 mm

Special requirements.

- Devices to be fitted as per drawing

Notes.

- Main neutral to be 16 mm²
- SPD cables to be 6 mm² tri-rated
- All cables to have ferruled connections.