



中国认可
国际互认
检测
TESTING
CNAS L2291



TEST REPORT

Product Name : Hybrid inverter

Model Number : HPS30, HPS50, HPS100, HPS120, HPS150

Prepared for : Shenzhen Ateess Power Technology Co., Ltd.
Address : 1st Floor of Building 3 at Sector B and 3rd Floor of Building 9, Henglong Industrial Park, No.4 Industrial Zone, Shuitian Community, Shiyan Street, Baoan District, Shenzhen

Prepared by : EMTEK (SHENZHEN) CO., LTD.
Address : Bldg 69, Majialong Industry Zone, Nanshan District, Shenzhen, Guangdong, China

Tel: (0755) 26954280
Fax: (0755) 26954282

Report Number : ES170725041E-1
Date(s) of Tests : August 01, 2017 to August 30, 2017
Date of Report : March 10, 2020



TABLE OF CONTENT

Test Report Description	Page
1. SUMMARY OF TEST RESULT	6
2. GENERAL INFORMATION	7
2.1. DESCRIPTION OF DEVICE (EUT)	7
2.2. DESCRIPTION OF TEST FACILITY	7
2.3. DESCRIPTION OF SUPPORT DEVICE	8
2.4. MEASUREMENT UNCERTAINTY	8
3. MEASURING DEVICE AND TEST EQUIPMENT	9
3.1. FOR POWER LINE CONDUCTED EMISSION	9
3.2. FOR 10M RADIATED EMISSION MEASUREMENT	9
3.3. FOR ELECTROSTATIC DISCHARGE IMMUNITY TEST	9
3.4. FOR RF STRENGTH SUSCEPTIBILITY TEST	10
3.5. FOR ELECTRICAL FAST TRANSIENT / BURST IMMUNITY TEST	10
3.6. FOR SURGE IMMUNITY TEST	10
3.7. FOR INJECTED CURRENT SUSCEPTIBILITY TEST	11
3.8. FOR MAGNETIC FIELD IMMUNITY TEST	11
3.9. FOR VOLTAGE DIPS AND INTERRUPTIONS TEST	11
4. CONDUCTED EMISSION MEASUREMENT	12
4.1. BLOCK DIAGRAM OF TEST SETUP	12
4.2. MEASURING STANDARD	12
4.3. CONDUCTED EMISSION LIMITS	12
4.4. EUT CONFIGURATION ON MEASUREMENT	12
4.5. OPERATING CONDITION OF EUT	12
4.6. TEST PROCEDURE	13
4.7. MEASURING RESULTS	13
5. RADIATED EMISSION MEASUREMENT	18
5.1. BLOCK DIAGRAM OF TEST SETUP	18
5.2. MEASURING STANDARD	18
5.3. RADIATED EMISSION LIMITS	18
5.4. EUT CONFIGURATION ON MEASUREMENT	19
5.5. OPERATING CONDITION OF EUT	19
5.6. TEST PROCEDURE	19
5.7. MEASURING RESULTS	19
6. IMMUNITY PERFORMANCE CRITERIA DESCRIPTION	22
7. ELECTROSTATIC DISCHARGE IMMUNITY TEST	23
7.1. BLOCK DIAGRAM OF TEST SETUP	23
7.2. TEST STANDARD	23
7.3. SEVERITY LEVELS AND PERFORMANCE CRITERION	23
7.4. OPERATING CONDITION OF EUT	23
7.5. TEST PROCEDURE	24
7.6. TEST RESULTS	24
8. RF FIELD STRENGTH SUSCEPTIBILITY TEST	26
8.1. BLOCK DIAGRAM OF TEST SETUP	26
8.2. TEST STANDARD	26
8.3. SEVERITY LEVELS AND PERFORMANCE CRITERION	27

8.4.	OPERATING CONDITION OF EUT	27
8.5.	TEST PROCEDURE	27
8.6.	TEST RESULTS	27
9.	ELECTRICAL FAST TRANSIENT/BURST IMMUNITY TEST	31
9.1.	BLOCK DIAGRAM OF TEST SETUP	31
9.2.	TEST STANDARD	31
9.3.	SEVERITY LEVELS AND PERFORMANCE CRITERION.....	31
9.4.	OPERATING CONDITION OF EUT	32
9.5.	TEST PROCEDURE	32
9.6.	TEST RESULTS	32
10.	SURGE IMMUNITY TEST	34
10.1.	BLOCK DIAGRAM OF TEST SETUP	34
10.2.	TEST STANDARD	34
10.3.	SEVERITY LEVELS AND PERFORMANCE CRITERION.....	34
10.4.	OPERATING CONDITION OF EUT	34
10.5.	TEST PROCEDURE	35
10.6.	TEST RESULTS	35
11.	INJECTED CURRENTS SUSCEPTIBILITY TEST.....	37
11.1.	BLOCK DIAGRAM OF TEST SETUP	37
11.2.	TEST STANDARD	37
11.3.	SEVERITY LEVELS AND PERFORMANCE CRITERION.....	37
11.4.	OPERATING CONDITION OF EUT	37
11.5.	TEST PROCEDURE	38
11.6.	TEST RESULTS	38
12.	MAGNETIC FIELD SUSCEPTIBILITY TEST.....	40
12.1.	BLOCK DIAGRAM OF TEST SETUP	40
12.2.	TEST STANDARD	40
12.3.	SEVERITY LEVELS AND PERFORMANCE CRITERION.....	40
12.4.	OPERATING CONDITION OF EUT	40
12.5.	TEST PROCEDURE	41
12.6.	TEST RESULTS	41
13.	VOLTAGE DIPS AND INTERRUPTIONS TEST	43
13.1.	BLOCK DIAGRAM OF TEST SETUP	43
13.2.	TEST STANDARD	43
13.3.	SEVERITY LEVELS AND PERFORMANCE CRITERION.....	43
13.4.	OPERATING CONDITION OF EUT	44
13.5.	TEST PROCEDURE	44
13.6.	TEST RESULTS	44
14.	PHOTOGRAPHS	46
14.1.	PHOTOS OF CONDUCTED EMISSION MEASUREMENT.....	46
14.2.	PHOTOS OF RADIATION EMISSION MEASUREMENT.....	46
14.3.	PHOTO OF ELECTROSTATIC DISCHARGE TEST.....	47
14.4.	PHOTO OF RF FIELD STRENGTH SUSCEPTIBILITY TEST	48
14.5.	PHOTO OF ELECTRICAL FAST TRANSIENT / BURST IMMUNITY TEST	49
14.6.	PHOTO OF SURGE TEST	49
14.7.	FOR INJECTED CURRENT SUSCEPTIBILITY TEST	50
14.8.	PHOTO OF MAGNETIC FIELD IMMUNITY TEST.....	50
14.9.	PHOTO OF VOLTAGE DIPS AND INTERRUPTION IMMUNITY TEST	51
	APPENDIX (Photos of EUT) (12 Page).....	

TEST REPORT DESCRIPTION

Applicant : Shenzhen Ateess Power Technology Co., Ltd.
 Manufacturer : Shenzhen Ateess Power Technology Co., Ltd.
 Trademark : 
 EUT : Hybrid inverter
 Model No. : HPS30, HPS50, HPS100, HPS120, HPS150
 Power Supply : 360-440V, 150kVA, 50/60Hz


Measurement Procedure Used:


EN 61000-6-4: 2007+A1: 2011
 EN 61000-6-2:2005
 (IEC61000-4-2:2008, IEC61000-4-3:2006+A1:2007+A2:2010, IEC 61000-4-4:2012,
 IEC61000-4-5:2014, IEC61000-4-6:2013, IEC 61000-4-8:2009, IEC 61000-4-11:2004)

The device described above is tested by EMTEK (SHENZHEN) CO., LTD. To determine the maximum emission levels emanating from the device and the severe levels of the device can endure and its performance criterion. The measurement results are contained in this test report and EMTEK (SHENZHEN) CO., LTD. Is assumed full of responsibility for the accuracy and completeness of these measurements. Also, this report shows that the EUT (Equipment Under Test) is technically compliant with the EN 61000-6-4 and EN 61000-6-2 requirements.

This report applies to above tested sample only and shall not be reproduced in part without written approval of EMTEK (SHENZHEN) CO., LTD.

Date of Test : August 01, 2017 to August 30, 2017

Prepared by : 
 Kaimin Guo/Editor

Reviewer : 
 Jessie Hu/Supervisor

Approved & Authorized Signer : 
 Lisa Wang/Manager

Modified Information

Version	Report No.	Revision Date	Summary
Ver.1.0	ES170725041E	/	Original Report
Ver.1.0	ES170725041E-1	2020-3-10	Change the name and address of the applicant and the manufacturer, trademark



1. SUMMARY OF TEST RESULT

EMISSION			
Description of Test Item	Standard	Limits	Results
Conducted Disturbance	EN 61000-6-4: 2007+A1: 2011	--	Pass
Radiated Disturbance	EN 61000-6-4: 2007+A1: 2011	--	Pass
IMMUNITY (EN 61000-6-2:2005)			
Description of Test Item	Basic Standard	Performance Criteria	Results
Electrostatic Discharge (ESD)	IEC61000-4-2:2008	B	Pass
Radio-Frequency, Continuous Radiated Disturbance	IEC61000-4-3:2006+A1:2007+A2:2010	A	Pass
EFT/B Immunity	IEC 61000-4-4:2012	B	Pass
Surge Immunity	IEC61000-4-5:2014	B	Pass
Conducted RF Immunity	IEC61000-4-6:2013	A	Pass
Power Frequency Magnetic Field	IEC 61000-4-8:2009	A	Pass
Voltage Dips and Voltage Interruptions	IEC 61000-4-11:2004	B,C	Pass
Note: N/A is an abbreviation for Not Applicable.			

2. GENERAL INFORMATION

2.1. Description of Device (EUT)

EUT	: Hybrid inverter
Model Number	: HPS30, HPS50, HPS100, HPS120, HPS150 (These models are identical in circuitry and electrical, mechanical and physical construction; the only difference are the model number and power. for trading purpose. We prepare HPS150 for test.)
Test Voltage	: AC 380V/50Hz
Applicant	: Shenzhen Ates Power Technology Co., Ltd.
Address	: 1st Floor of Building 3 at Sector B and 3rd Floor of Building 9, Henglong Industrial Park, No.4 Industrial Zone, Shuitian Community, Shiyan Street, Baoan District, Shenzhen
Manufacturer	: Shenzhen Ates Power Technology Co., Ltd.
Address	: 1st Floor of Building 3 at Sector B and 3rd Floor of Building 9, Henglong Industrial Park, No.4 Industrial Zone, Shuitian Community, Shiyan Street, Baoan District, Shenzhen
Date of Received	: August 01, 2017
Date of Test	: August 01, 2017 to August 30, 2017

2.2. Description of Test Facility

Site Description EMC Lab.	: Accredited by CNAS, 2018.11.30 The certificate is valid until 2022.10.28 The Laboratory has been assessed and proved to be in compliance with CNAS-CL01:2006 (identical to ISO/IEC 17025:2017) The Certificate Registration Number is L2291. Accredited by FCC, August 09, 2018 Designation Number: CN1204 Test Firm Registration Number: 882943 Accredited by A2LA, August 08, 2018 The Certificate Number is 4321.01. Accredited by Industry Canada, November 09, 2018 The Conformity Assessment Body Identifier is CN0008
Name of Firm	: EMTEK (SHENZHEN) CO., LTD.
Site Location	: Bldg 69, Majialong Industry Zone, Nanshan District, Shenzhen, Guangdong, China

2.3. Description of Support Device

N/A

2.4. Measurement Uncertainty

Test Item	Uncertainty
Conducted Emission Uncertainty	: 2.96dB(9k~150kHz Conduction 1#) 2.74dB(150k-30MHz Conduction 1#)
Radiated Emission Uncertainty (10m Chamber)	: 3.96dB (30M~1GHz Polarize: H) 4.04dB (30M~1GHz Polarize: V)
Uncertainty for C/S Test	: 1.45(Using CDN Test)
Uncertainty for R/S Test	: 2.10dB(80MHz-200MHz) 1.76dB(200MHz-1000MHz)
Uncertainty for test site temperature and humidity	: 0.6°C 4%

3. MEASURING DEVICE AND TEST EQUIPMENT

3.1. For Power Line Conducted Emission

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
☒	Test Receiver	Rohde & Schwarz	ESCI	26115-010-0027	May 20, 2017	1 Year
☒	L.I.S.N.	Rohde & Schwarz	ENV216	101161	May 20, 2017	1 Year
☒	50Ω Coaxial Switch	Anritsu	MP59B	6100175589	May 21, 2017	1 Year
☒	Voltage Probe	Rohde & Schwarz	ESH2-Z3	100122	May 21, 2017	1 Year

3.2. For 10m Radiated Emission Measurement

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
☒	EMI Test Receiver	Rohde & Schwarz	ESR3	1316.3003K03-101706-HN	May 21, 2017	1 Year
☒	EMI Test Receiver	Rohde & Schwarz	ESR3	1316.3003K03-101707-Z1	May 21, 2017	1 Year
☒	Pre-Amplifier	Lunar EM	LNA10M1G-40	J1011130912001	May 20, 2017	1 Year
☒	Pre-Amplifier	Lunar EM	LNA10M1G-40	J1011131126002	May 20, 2017	1 Year
☒	Bilog Antenna	Schwarzbeck	VULB9163	659	May 20, 2017	1 Year
☒	Bilog Antenna	Schwarzbeck	VULB9163	661	May 21, 2017	1 Year
☒	Cable	Times Microwave	LMR-240 N-N 1m	SS26-P1	May 21, 2017	1 Year
☒	Cable	Times Microwave	LMR-240 N-N 1m	SS26-P2	May 21, 2017	1 Year
☒	Cable	Times Microwave	LMR-240 N-N 1.5m	N/A	May 21, 2017	1 Year
☒	Cable	Times Microwave	LMR-240 N-N 1.5m	N/A	May 21, 2017	1 Year
☒	Cable	Times Microwave	LMR-240 N-N 12m	N/A	May 21, 2017	1 Year
☒	Cable	Times Microwave	LMR-240 N-N 11m	N/A	May 21, 2017	1 Year

3.3. For Electrostatic Discharge Immunity Test

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
☒	ESD Tester	TESEQ AG	NSG 438A	130	May 21, 2017	1 Year
☒	Impulse Module	TESEQ AG	IN NSG 438A A 4380-150pF/3 30Ohm	403-550/1712	May 21, 2017	1 Year

3.4. For RF Strength Susceptibility Test

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
☒	Signal Generator	Agilent	N5181A	MY50145187	May 20, 2017	1 Year
☒	RF Power Meter. Dual Channel	BOONTON	4232A	10539	May 21, 2017	1 Year
☒	50ohm Diode Power Sensor	BOONTON	51011EMC	34236/34238	May 21, 2017	1 Year
☒	Field Strength Meter	DARE	RSS1006A	10I00037SO2 2	May 21, 2017	1 Year
☒	50ohm Diode Power Sensor	BOONTON	51011EMC	36164	May 21, 2017	1 Year
☒	Power Amplifier	MILMEGA	80RF1000-17 5	1059345	May 20, 2017	1 Year
☒	Power Amplifier	MILMEGA	AS0102-55	1018770	May 20, 2017	1 Year
☒	Power Amplifier	MILMEGA	AS1860-50	1059346	May 20, 2017	1 Year
☒	Log.-Per. Antenna	SCHWARZBE CK	VULP 9118E	811	May 21, 2017	1 Year
☒	Broad-Band Horn Antenna	SCHWARZBE CK	STLP 9149	9149-227	May 21, 2017	1 Year
☒	Multi-function interface system	DARE	CTR1009B	12I00250SNO 72	N/A	N/A
☒	Automatic switch group	DARE	RSW1004A	N/A	N/A	N/A

3.5. For Electrical Fast Transient / Burst Immunity Test

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
☒	Burst Tester	HAEFELY	PEFT4010	080981-16	May 21, 2017	1Year
☒	Coupling Clamp	HAEFELY	IP-4A	147147	May 21, 2017	1Year
☒	Three phase CDN	Teseq	CDN 163	202	May 21, 2017	1 Year

3.6. For Surge Immunity Test

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
☒	Surge Controller	HAEFELY	Psurge 8000	174031	May 21, 2017	1Year
☒	Impulse Module	HAEFELY	PIM 100	174124	May 21, 2017	1Year
☒	Coupling Decoupling Filter	HAEFELY	PCD 130	172181	May 21, 2017	1Year
☒	Coupling Module	HAEFELY	PCD122	174354	May 21, 2017	1Year
☒	Surge Impulse Module	HAEFELY	PIM 120	174435	May 21, 2017	1Year
☒	Coupling Module	HAEFELY	PCD 126A	174387	May 21, 2017	1Year
☒	Impulse Module	HAEFELY	PIM 110	174391	May 21, 2017	1Year
☒	Impulse Module	HAEFELY	PIM 150	178707	May 21, 2017	1Year

3.7. For Injected Current Susceptibility Test

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
☒	Simulator	EMTEST	CWS500C	0900-12	May 21, 2017	1Year
☒	CDN	EMTEST	CDN-M2	5100100100	May 21, 2017	1Year
☒	CDN	EMTEST	CDN-M3	0900-11	May 21, 2017	1Year
☒	Injection Clamp	EMTEST	F-2031-23MM	368	May 21, 2017	1Year
☒	Attenuator	EMTEST	ATT6	0010222A	May 21, 2017	1Year
☒	Three phase CDN	Teseq	CDN M332S	32655	May 21, 2017	1 Year

3.8. For Magnetic Field Immunity Test


Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
☒	Magnetic Field Tester	HAEFELY	MAG100	250040.1	May 20, 2017	1Year

3.9. For Voltage Dips and Interruptions Test

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
☒	45KVA AC Power source	Teseq	NSG 1007-45/45KVA	1305A02873	May 20, 2017	1 Year
☐	Signal conditioning Unit	Teseq	CCN 1000-3	1305A02873	May 20, 2017	1 Year
☐	Three phase impedance network	Teseq/Germany	INA2197/37A	1305A02873	May 20, 2017	1 Year
☐	Three phase impedance network	Teseq/Germany	INA 2196/75A	1305A02874	May 20, 2017	1 Year
☒	Proflin 2100 AC Switching Unit	Teseq/Germany	NSG2200-3	A22714	May 20, 2017	1 Year

4. CONDUCTED EMISSION MEASUREMENT

4.1. Block Diagram of Test Setup

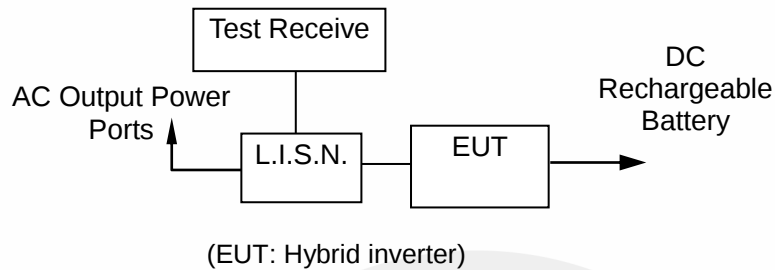

4.2. Measuring Standard

EN 61000-6-4: 2007+A1: 2011

4.3. Conducted Emission Limits

Frequency (MHz)	Limit (dB μ V)	
	Quasi-peak Level	Average Level
0.15 ~ 0.50	79.0	66.0
0.50 ~ 30.00	73.0	60.0
NOTE 1-The lower limit shall apply at the transition frequencies.		

4.4. EUT Configuration on Measurement

The following equipments are installed on Conducted Emission Measurement to meet EN 61000-6-4 requirements and operating in a manner which tends to maximize its emission characteristics in a normal application.

EUT : Hybrid inverter
Model Number : HPS150

4.5. Operating Condition of EUT

4.5.1. Setup the EUT as shown on Section 4.1.

4.5.2. Turn on the power of all equipment.

4.5.3. Let the EUT work in measuring mode (ON) and measure it.

4.6. Test Procedure

The EUT is put on the plane 0.1m high above the ground by insulating support and the AC Output Power Ports connected to the AC mains through Line Impedance Stability Network (L.I.S.N). This provided a 50ohm coupling impedance for the tested equipments. All of the output lines are investigated to find out the maximum conducted emission according to the EN 61000-6-4 regulations during conducted emission measurement.

The bandwidth of the field strength meter (R&S Test Receiver ESCS30) is set at 9kHz in 150kHz~30MHz and 200Hz in 9kHz~150kHz.

The frequency range from 150kHz to 30MHz is investigated.


All the scanning waveform is put in the following pages.

4.7. Measuring Results

PASS.

Please see the attached pages.



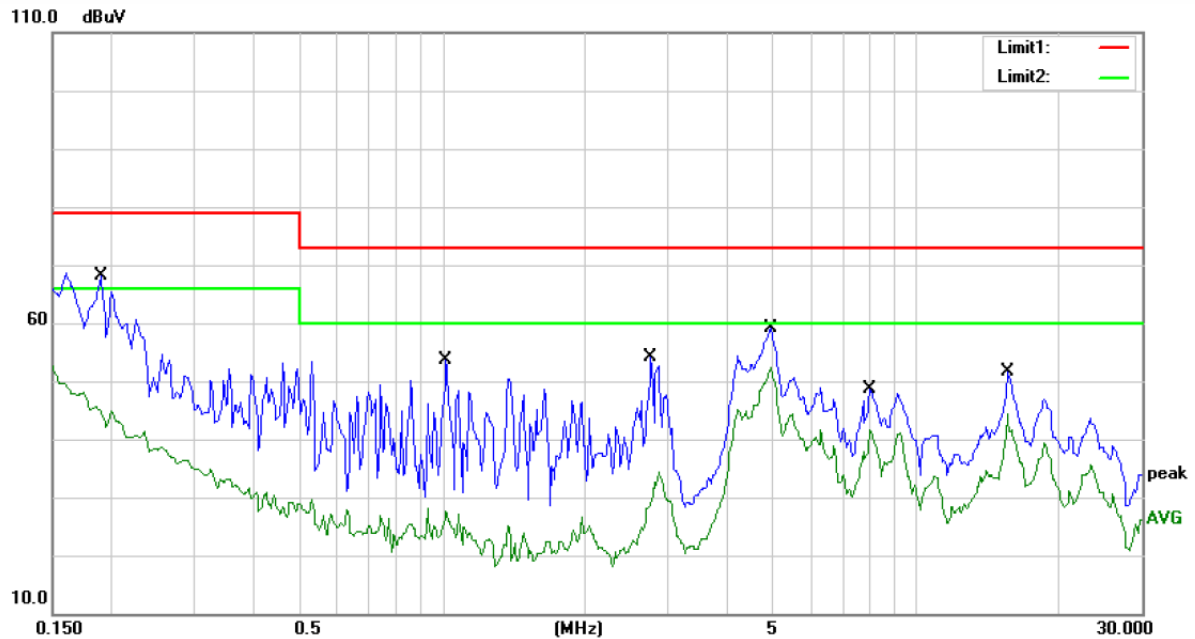

Site :10m Chamber #1

Phase: **L1**

Temperature: 26

Limit: (CE)EN61000-6-4_QP

Power: AC 380V/50Hz


Humidity: 60 %

Mode: ON

Note:

No.	Mk.	Freq.	Reading	Correct	Measure-	Limit	Over		
		MHz	Level	Factor	ment			Detector	Comment
			dBuV	dB	dBuV	dBuV	dB		
1		0.1900	68.21	0.00	68.21	79.00	-10.79	QP	
2		0.1900	48.12	0.00	48.12	66.00	-17.88	AVG	
3		1.0200	53.53	0.00	53.53	73.00	-19.47	QP	
4		1.0200	28.03	0.00	28.03	60.00	-31.97	AVG	
5		2.7600	54.07	0.00	54.07	73.00	-18.93	QP	
6		2.7600	34.36	0.00	34.36	60.00	-25.64	AVG	
7		4.9300	59.19	0.00	59.19	73.00	-13.81	QP	
8	*	4.9300	52.42	0.00	52.42	60.00	-7.58	AVG	
9		8.0000	48.53	0.00	48.53	73.00	-24.47	QP	
10		8.0000	41.57	0.00	41.57	60.00	-18.43	AVG	
11		15.5750	51.62	0.00	51.62	73.00	-21.38	QP	
12		15.5750	44.33	0.00	44.33	60.00	-15.67	AVG	

*:Maximum data x:Over limit !:over margin Comment: Factor build in receiver. Operator: CSL

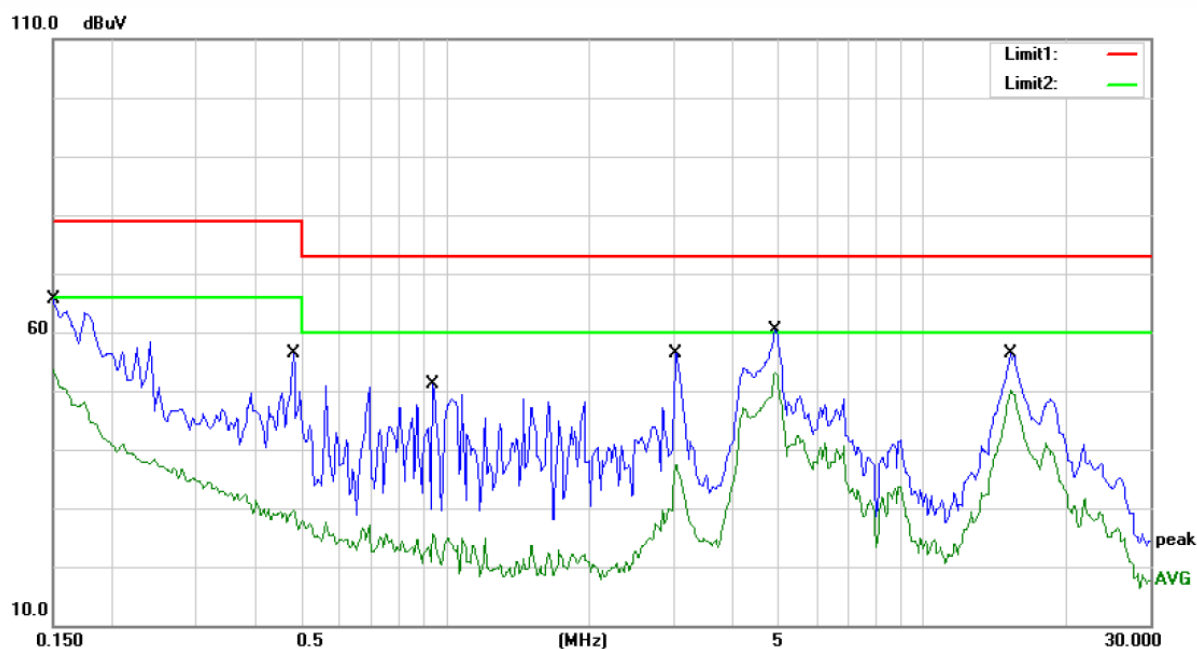

Site :10m Chamber #1

Phase: L2

Temperature: 26

Limit: (CE)EN61000-6-4_QP

Power: AC 380V/50Hz

Humidity: 60 %

Mode: ON


Note:

No.	Mk.	Freq.	Reading	Correct	Measure-	Limit	Over		
		MHz	Level	Factor	ment			Detector	Comment
			dBuV	dB	dBuV	dBuV	dB		
1		0.1500	65.72	0.00	65.72	79.00	-13.28	QP	
2		0.1500	53.74	0.00	53.74	66.00	-12.26	AVG	
3		0.4800	56.27	0.00	56.27	79.00	-22.73	QP	
4		0.4800	29.63	0.00	29.63	66.00	-36.37	AVG	
5		0.9400	51.03	0.00	51.03	73.00	-21.97	QP	
6		0.9400	25.68	0.00	25.68	60.00	-34.32	AVG	
7		3.0400	56.49	0.00	56.49	73.00	-16.51	QP	
8		3.0400	37.31	0.00	37.31	60.00	-22.69	AVG	
9		4.9000	60.46	0.00	60.46	73.00	-12.54	QP	
10	*	4.9000	53.15	0.00	53.15	60.00	-6.85	AVG	
11		15.2500	56.33	0.00	56.33	73.00	-16.67	QP	
12		15.2500	50.18	0.00	50.18	60.00	-9.82	AVG	

*:Maximum data x:Over limit !:over margin

Comment: Factor build in receiver.

Operator: CSL

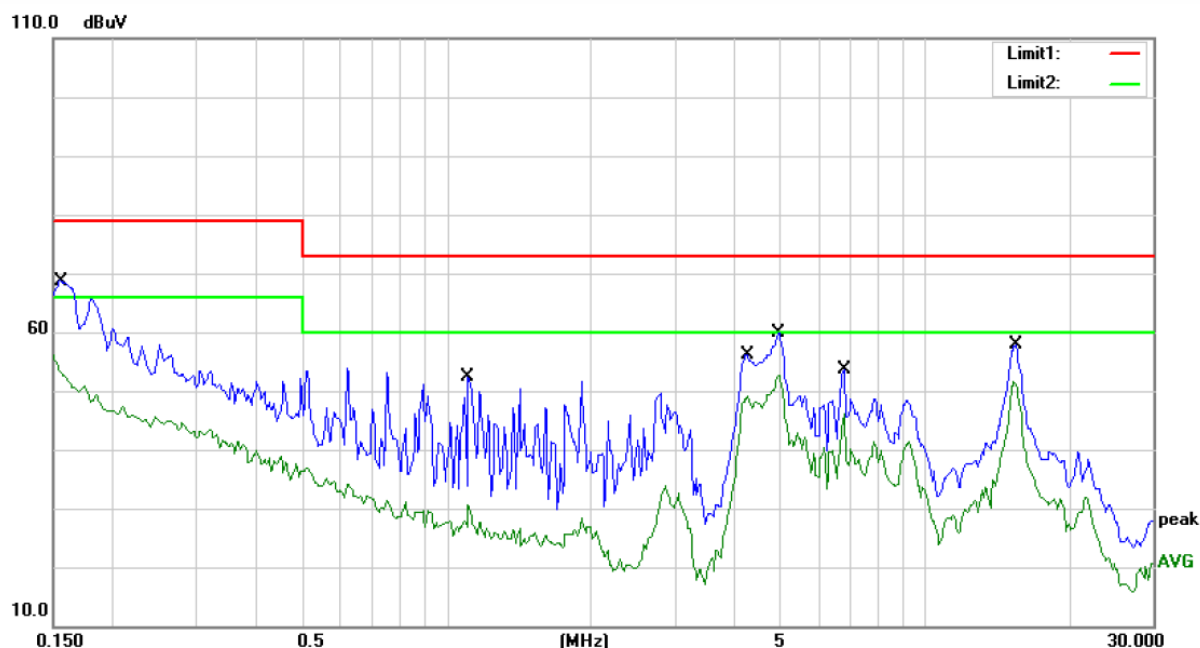

Site :10m Chamber #1

Phase: L3

Temperature: 26

Limit: (CE)EN61000-6-4_QP

Power: AC 380V/50Hz


Humidity: 60 %

Mode: ON

Note:

No.	Mk.	Freq.	Reading	Correct	Measure-	Limit	Over		
		MHz	Level	Factor	ment			Detector	Comment
			dBuV	dB	dBuV	dBuV	dB		
1		0.1573	68.50	0.00	68.50	79.00	-10.50	QP	
2		0.1573	56.15	0.00	56.15	66.00	-9.85	AVG	
3		1.1100	52.39	0.00	52.39	73.00	-20.61	QP	
4		1.1100	30.60	0.00	30.60	60.00	-29.40	AVG	
5		4.2600	56.07	0.00	56.07	73.00	-16.93	QP	
6		4.2600	49.19	0.00	49.19	60.00	-10.81	AVG	
7		4.9500	59.82	0.00	59.82	73.00	-13.18	QP	
8	*	4.9500	52.67	0.00	52.67	60.00	-7.33	AVG	
9		6.8000	53.55	0.00	53.55	73.00	-19.45	QP	
10		6.8000	46.04	0.00	46.04	60.00	-13.96	AVG	
11		15.4750	57.97	0.00	57.97	73.00	-15.03	QP	
12		15.4750	51.56	0.00	51.56	60.00	-8.44	AVG	

*:Maximum data x:Over limit !:over margin Comment: Factor build in receiver. Operator: CSL

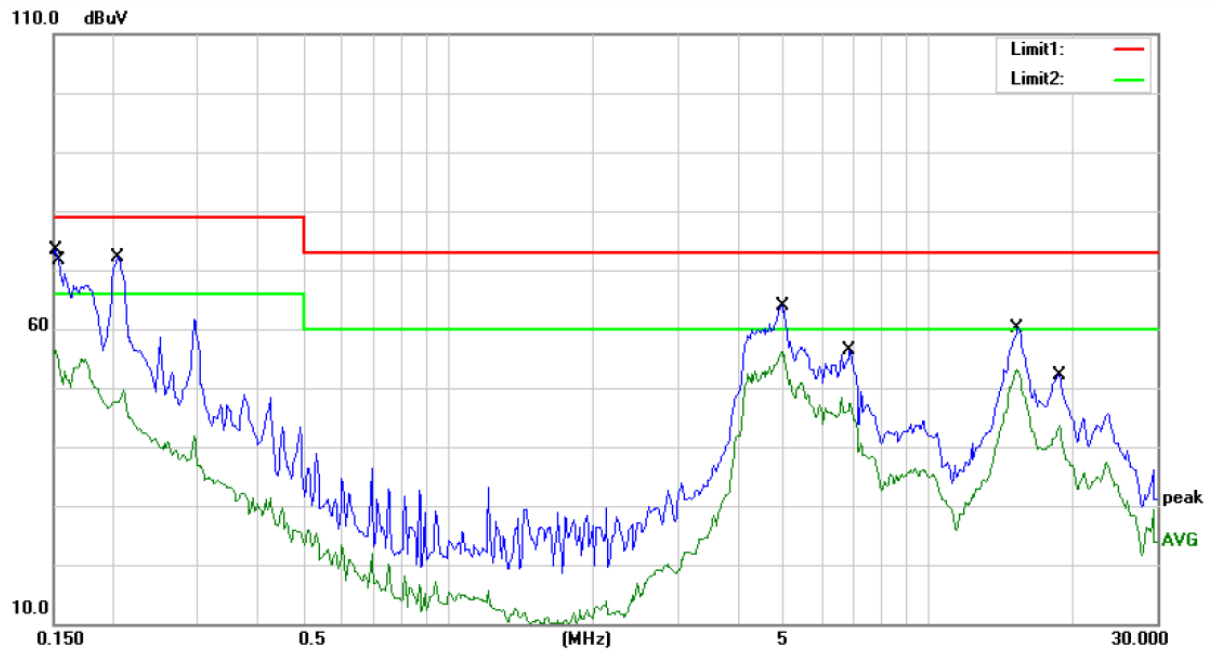

Site :10m Chamber #1

Phase: **N**

Temperature: 26

Limit: (CE)EN61000-6-4_QP

Power: AC 380V/50Hz

Humidity: 60 %

Mode: ON

Note:


No.	Mk.	Freq. MHz	Reading Level dBuV	Correct Factor dB	Measure- ment dBuV	Limit dBuV	Over dB	Detector	Comment
1		0.1516	73.40	0.00	73.40	79.00	-5.60	QP	
2		0.1560	56.42	0.00	56.42	66.00	-9.58	AVG	
3		0.2050	72.08	0.00	72.08	79.00	-6.92	QP	
4		0.2050	49.71	0.00	49.71	66.00	-16.29	AVG	
5		4.9518	63.92	0.00	63.92	73.00	-9.08	QP	
6	*	4.9518	56.23	0.00	56.23	60.00	-3.77	AVG	
7		6.8750	56.33	0.00	56.33	73.00	-16.67	QP	
8		6.8750	48.31	0.00	48.31	60.00	-11.69	AVG	
9		15.3500	60.18	0.00	60.18	73.00	-12.82	QP	
10		15.3500	53.21	0.00	53.21	60.00	-6.79	AVG	
11		18.7500	52.22	0.00	52.22	73.00	-20.78	QP	
12		18.7500	43.61	0.00	43.61	60.00	-16.39	AVG	

*:Maximum data x:Over limit !:over margin Comment: Factor build in receiver. Operator: CSL


5. RADIATED EMISSION MEASUREMENT

5.1. Block Diagram of Test Setup

5.1.1. Block diagram of EUT System

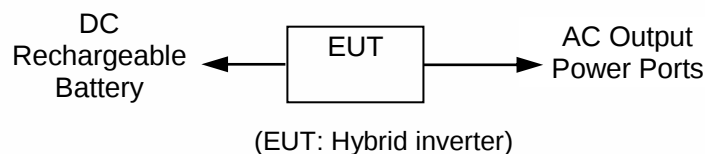

5.1.2. Block diagram of test setup (In chamber)

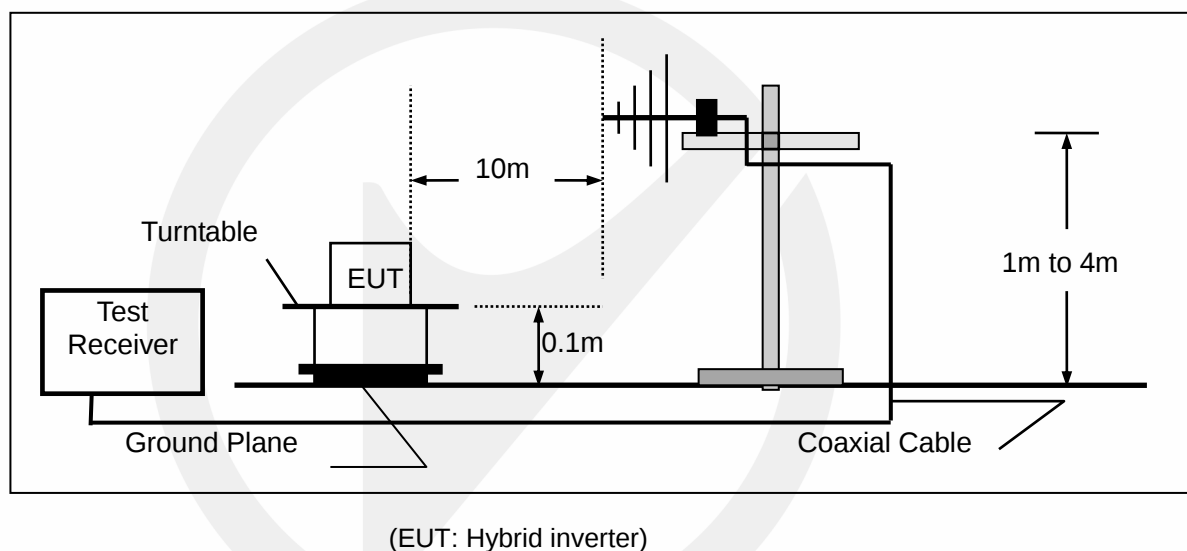

5.2. Measuring Standard

EN 61000-6-4: 2007+A1: 2011

5.3. Radiated Emission Limits

FREQUENCY (MHz)	DISTANCE (Meters)	FIELD STRENGTHS LIMIT (dB μ V/m)
30 ~ 230	10	40
230 ~ 1000	10	47

Note: (1) The smaller limit shall apply at the combination point between two frequency bands.
(2) Distance refers to the distance in meters between the measuring instrument antenna and the closed point of any part of the EUT.

5.4. EUT Configuration on Measurement

The EN 61000-6-4 regulations test method must be used to find the maximum emission during radiated emission measurement.

EUT : Hybrid inverter
Model Number : HPS150

5.5. Operating Condition of EUT

5.5.1. Setup the EUT as shown on Section 5.1.

5.5.2. Turn on the power of all equipment.

5.5.3. Let the EUT work in measuring mode (ON) and measure it.

5.6. Test Procedure

The EUT is placed on a turntable which is 0.1 meter high above the ground. The turntable can rotate 360 degrees to determine the position of the maximum emission level. The EUT is set 10 meters away from the receiving antenna that is mounted on an antenna tower. The antenna can be moved up and down from 1 to 4 meters to find out the maximum emission level. Bilog antenna (calibrated by Dipole Antenna) is used as a receiving antenna. Both horizontal and vertical polarization of the antenna is set on test.

The bandwidth of the Receiver is set at 120kHz.


All the modes were tested and the data of the worsted mode(ON) are attached in the following pages.

5.7. Measuring Results

PASS.

The frequency range from 30MHz to 1000MHz is investigated.

Please see the attached pages.

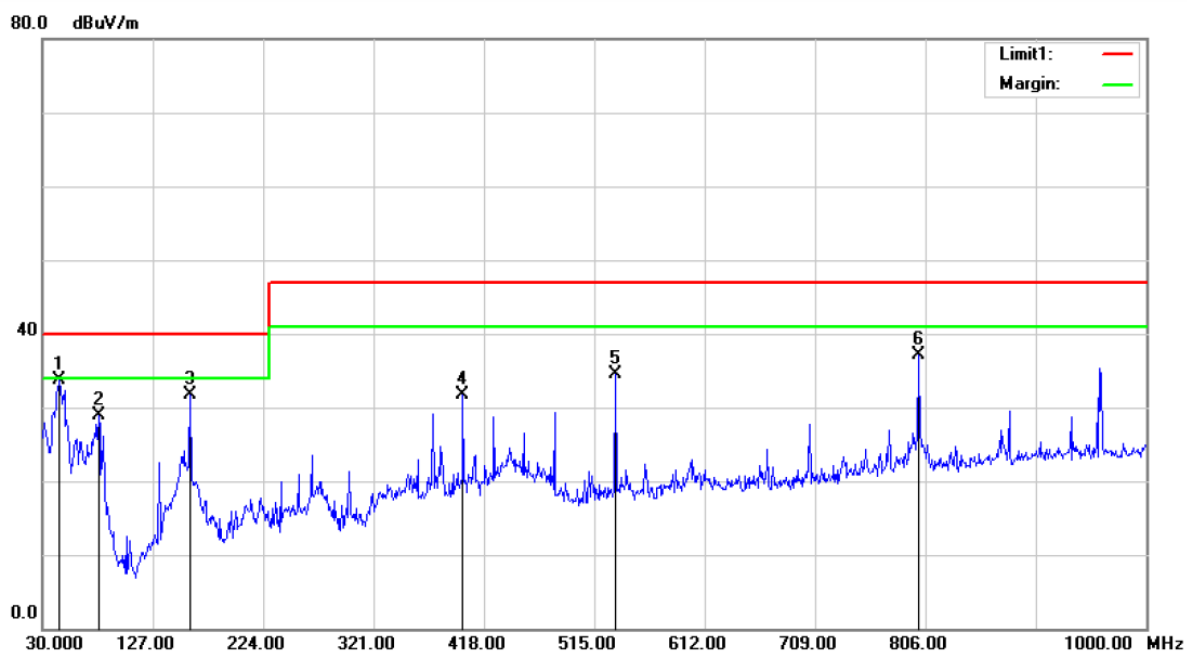

Site :10m Chamber #1

Polarization: **Horizontal**

Temperature: 26

Limit: (RE 10M)EN61000-6-4

Power: AC 380V/50Hz

Humidity: 60 %


Mode:ON

Note:

No.	Mk.	Freq.	Reading	Correct	Measure-	Limit	Over	Antenna	Table	
		MHz	Level	Factor	ment			Height	Degree	
			dBuV	dB	dBuV/m	dBuV/m	dB	cm	degree	Comment
1	*	44.5500	63.14	-29.35	33.79	40.00	-6.21	QP	158	41
2		79.4700	63.99	-35.18	28.81	40.00	-11.19	QP	303	0
3		159.9800	65.14	-33.41	31.73	40.00	-8.27	QP	303	8
4		399.5700	54.99	-23.29	31.70	47.00	-15.30	QP	158	51
5		533.4300	55.01	-20.42	34.59	47.00	-12.41	QP	303	10
6		800.1800	53.30	-16.21	37.09	47.00	-9.91	QP	158	339

*:Maximum data x:Over limit !:over margin

Operator: CSL

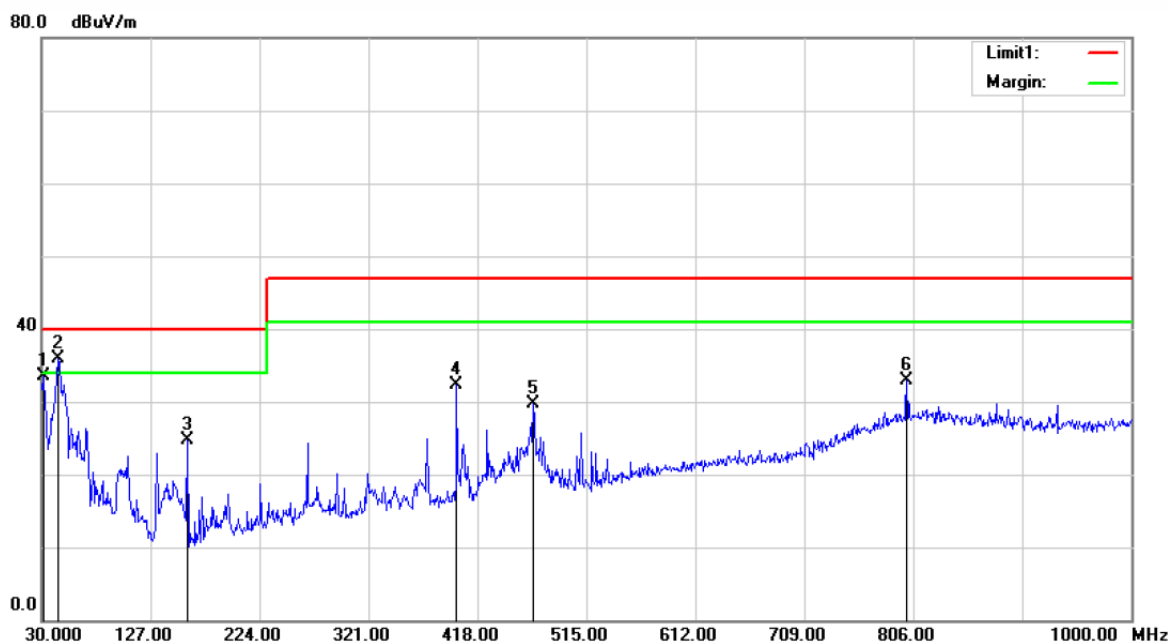

Site :10m Chamber #1

Polarization: *Vertical*

Temperature: 26

Limit: (RE 10M)EN61000-6-4

Power: AC 380V/50Hz

Humidity: 60 %

Mode:ON

Note:

No.	Mk.	Freq.	Reading Level	Correct Factor	Measure-ment	Limit	Over	Antenna Height	Table Degree	
		MHz	dBuV	dB	dBuV/m	dBuV/m	dB	Detector	cm	degree
1		31.9400	64.89	-31.34	33.55	40.00	-6.45	QP	100	17
2	*	44.5500	66.36	-30.44	35.92	40.00	-4.08	QP	200	289
3		159.9800	57.69	-33.05	24.64	40.00	-15.36	QP	100	3
4		399.5700	54.78	-22.43	32.35	47.00	-14.65	QP	200	322
5		467.4700	50.35	-20.72	29.63	47.00	-17.37	QP	200	349
6		800.1800	42.48	-9.59	32.89	47.00	-14.11	QP	100	324

*:Maximum data x:Over limit !:over margin

Operator: CSL

6. IMMUNITY PERFORMANCE CRITERIA DESCRIPTION

Performance Level

The test results shall be classified in terms of the loss of function or degradation of performance of the equipment under test, relative to a performance level by its manufacturer or the requestor of the test, or the agreed between the manufacturer and the purchaser of the product.

Definition related to the performance level:

1. Based on the used product standard
2. Based on the declaration of the manufacturer, requestor or purchaser

Criterion A:

Definition: normal performance within limits specified by the manufacturer, requestor and purchaser.

The equipment shall continue to operate as intended without operator intervention. No degradation of performance or loss of function is allowed below a performance level specified by the manufacturer when the equipment is used as intended. The performance level may be replaced by a permissible loss of performance. If the minimum performance level or the permissible performance loss is not specified by the manufacturer, then either of these may be derived from the product description and documentation, and by what the user may reasonably expect from the equipment if used as intended.

Criterion B:

Definition: temporary loss of function or degradation of performance which ceases after the disturbance ceases, and from which the equipment under test recovers its normal performance, without operator intervention.

After the test, the EUT shall continue to operate as intended without operator intervention. No degradation of performance or loss of function is allowed, after the application of the phenomena below a performance level specified by the manufacturer, when the EUT is used as intended. The performance level may be replaced by a permissible loss of performance. During the test, degradation of performance is allowed. However, no change of operating state or stored data is allowed to persist after the test. If the minimum performance level (or the permissible performance loss) is not specified by the manufacturer, then either of these may be derived from the product description and documentation, and by what the user may reasonably expect from the EUT if used as intended.

Criterion C:


Definition: temporary loss of function or degradation of performance, the correction of which requires operator intervention.

Loss of function is allowed, provided the function is self-recoverable, or can be restored by the operation of the controls by the user in accordance with the manufacturer's instructions. Functions, and/or information stored in non-volatile memory, or protected by a battery backup, shall not be lost.


7. ELECTROSTATIC DISCHARGE IMMUNITY TEST

7.1. Block Diagram of Test Setup

7.1.1. Block diagram of EUT System

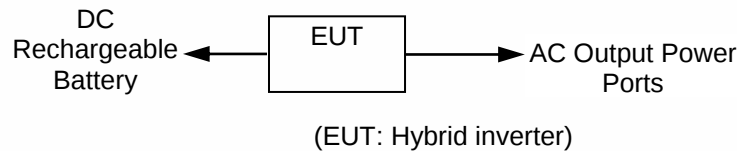

7.1.2. Block diagram of ESD test setup

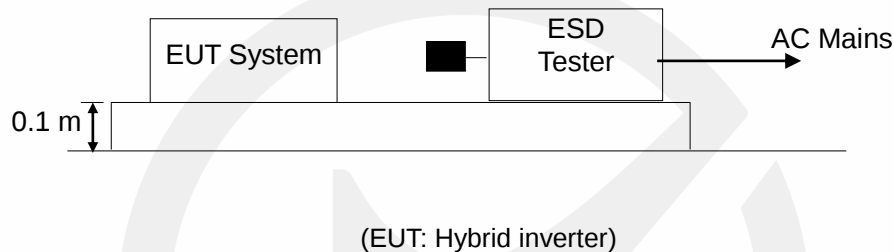

7.2. Test Standard

EN 61000-6-2:2005
(IEC61000-4-2:2008 Severity Level: 3 / Air Discharge: $\pm 8\text{kV}$;
Level: 2 / Contact Discharge: $\pm 4\text{kV}$)

7.3. Severity Levels and Performance Criterion

7.3.1. Severity level

Level	Test Voltage Contact Discharge (kV)	Test Voltage Air Discharge (kV)
1	± 2	± 2
2	± 4	± 4
3	± 6	± 8
4	± 8	± 15
X	Special	Special

7.3.2. Performance criterion: B

7.4. Operating Condition of EUT

7.4.1. Setup the EUT as shown on Section 7.1.

7.4.2. Turn on the power of all equipment.

7.4.3. Let the EUT work in test mode (ON) and test it.

7.5. Test Procedure

7.5.1. Air Discharge:

This test is done on a non-conductive surface. The round discharge tip of the discharge electrode shall be approached as fast as possible to touch the EUT. After each discharge, the discharge electrode shall be removed from the EUT. The generator is then re-triggered for a new single discharge and repeated 10 times for each pre-selected test point. This procedure shall be repeated until all the air discharge completed.

7.5.2. Contact Discharge:

All the procedure shall be same as Section 7.5.1. Except that the tip of the discharge electrode shall touch the EUT before the discharge switch is operated.

7.5.3. Indirect discharge for horizontal coupling plane

At least 10 single discharges (in the most sensitive polarity) shall be applied at the front edge of each HCP opposite the center point of each unit (if applicable) of the EUT and 0.1m from the front of the EUT. The long axis of the discharge electrode shall be in the plane of the HCP and perpendicular to its front edge during the discharge.

7.5.4. Indirect discharge for vertical coupling plane

At least 10 singles discharge (in the most sensitive polarity) shall be applied to the center of one vertical edge of the coupling plane. The coupling plane, of dimensions 0.5m×0.5m, is placed parallel to, and positioned at a distance of 0.1m from the EUT. Discharges shall be applied to the coupling plane, with this plane in sufficient different positions that the four faces of the EUT are completely illuminated.

7.6. Test Results

PASS.

Please refer to the following page.

Electrostatic Discharge Test Results


EMTEK (SHENZHEN) CO., LTD.

Applicant	:	Shenzhen Ateess Power Technology Co., Ltd.			
EUT	:	Hybrid inverter	Test Date	:	August 28, 2017
M/N	:	HPS150	Temperature	:	22°C
Power Supply	:	AC 380V/50Hz	Humidity	:	50%
Air discharge	:	± 8.0kV	Test Mode	:	ON
Contact discharge:		± 4.0kV	Criterion	:	B
Location			Kind A-Air Discharge C-Contact Discharge		Result
Slot			A		A
Metal			C		A
Screw			C		A
Screen			A		A
HCP of all sides			C		A
VCP of front			C		A
VCP of rear			C		A
VCP of left			C		A
VCP of right			C		A
Note:					


8. RF FIELD STRENGTH SUSCEPTIBILITY TEST

8.1. Block Diagram of Test Setup

8.1.1. Block diagram of EUT System

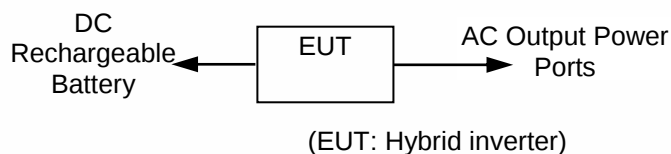

8.1.2. Block diagram of RS test setup

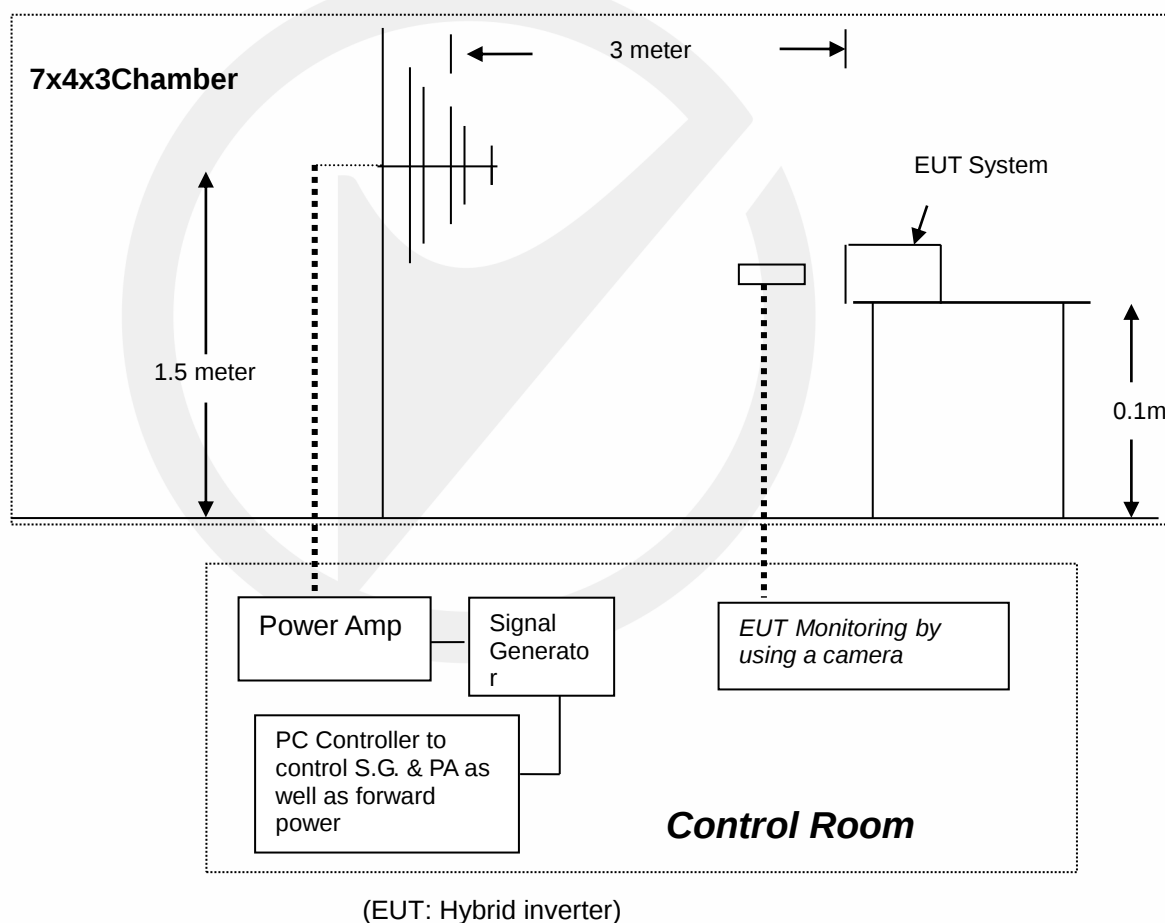

8.2. Test Standard

EN 61000-6-2:2005 (IEC61000-4-3:2006+A1:2007+A2:2010,
Severity Level: 1 V/m, 3 V/m, 10 V/m)

8.3. Severity Levels and Performance Criterion

8.3.1. Severity Levels

Level	Field Strength V/m
1.	1
2.	3
3.	10
X	Special

8.3.2. Performance Criterion: A

8.4. Operating Condition of EUT

8.4.1. Setup the EUT as shown on Section 8.1.

8.4.2. Turn on the power of all equipment.

8.4.3. Let the EUT work in test mode (ON) and test it.

8.5. Test Procedure

The EUT are placed on a table that is 0.1 meter high above the ground. The EUT is set 3 meters away from the transmitting antenna that is mounted on an antenna tower. Both horizontal and vertical polarization of the antenna is set on test. Each of the four sides of the EUT must be faced this transmitting antenna and measured individually.

In order to judge the EUT performance, a CCD camera is used to monitor it.

All the scanning conditions are as following:

Condition of Test	Remark
1. Fielded Strength	1V/m (Severity Level 1) 3V/m (Severity Level 2) 10V/m (Severity Level 3)
2. Radiated Signal	Modulated
3. Scanning Frequency	80-2700MHz
4. Sweep time of radiated	0.0015 Decade/s
5. Dwell Time	1 Sec.

8.6. Test Results

PASS.

Please refer to the following pages.

RF Field Strength Susceptibility Test Results

EMTEK (SHENZHEN) CO., LTD.

Applicant : Shenzhen Ateess Power Technology Co., Ltd.				
EUT : Hybrid inverter		Test Date : August 28, 2017		
M/N : HPS150		Temperature : 22°C		
Field Strength : 10 V/m		Humidity : 50%		
Power Supply : AC 380V/50Hz		Criterion : A		
Test Mode : ON		Frequency Range : 80MHz to 1000MHz		
Modulation: ☐ None ☐ Pulse ☒ AM 1kHz 80%				
Frequency Rang 1: 80~ 1000MHz		Frequency Rang 2: N/A		
Steps	1%			
	Horizontal	Vertical	Horizontal	Vertical
Front	A	A		
Right	A	A		
Rear	A	A		
Left	A	A		
Test Equipment: 1. Signal Generator: 2023B (AEROFLEX) 2. Power Amplifier: AS0102-55 (MILMEGA) & AP32MT215 (PRANA) 3. Log.-Per. Antenna: VULP9118E (SCHWARZBECK) 4. Broad-Band Horn Antenna: BBHA 9120L3F (SCHWARZBECK) 5. RF Power Meter. Dual Channel: 4232A (BOONTON) 6. Field Strength Meter: HI-6005 (HOLADAY)				
Note:				

RF Field Strength Susceptibility Test Results

EMTEK (SHENZHEN) CO., LTD.

Applicant	Shenzhen Ateess Power Technology Co., Ltd.			
EUT	Hybrid inverter		Test Date	August 28, 2017
M/N	HPS150		Temperature	22°C
Field Strength	3 V/m		Humidity	50%
Power Supply	AC 380V/50Hz		Criterion	A
Test Mode	ON		Frequency Range	1.4GHz to 2GHz
Modulation: ☐ None ☐ Pulse ☒ AM 1kHz 80%				
Frequency Rang 1:		Frequency Rang 2: N/A		
1.4GHz to 2GHz				
Steps	1%			
	Horizontal	Vertical	Horizontal	Vertical
Front	A	A		
Right	A	A		
Rear	A	A		
Left	A	A		
Test Equipment: 1. Signal Generator: 2023B (AEROFLEX) 2. Power Amplifier: AS0102-55 (MILMEGA) & AP32MT215 (PRANA) 3. Log.-Per. Antenna: VULP9118E (SCHWARZBECK) 4. Broad-Band Horn Antenna: BBHA 9120L3F (SCHWARZBECK) 5. RF Power Meter. Dual Channel: 4232A (BOONTON) 6. Field Strength Meter: HI-6005 (HOLADAY)				
Note:				

RF Field Strength Susceptibility Test Results


EMTEK (SHENZHEN) CO., LTD.

Applicant	: Shenzhen Ates Power Technology Co., Ltd.			
EUT	: Hybrid inverter		Test Date	: August 28, 2017
M/N	: HPS150		Temperature	: 22°C
Field Strength	: 1 V/m		Humidity	: 50%
Power Supply	: AC 380V/50Hz		Criterion	: A
Test Mode	: ON		Frequency Range	: 2GHz to 2.7GHz
Modulation: ☐ None ☐ Pulse ☒ AM 1kHz 80%				
Frequency Rang 1:		Frequency Rang 2: N/A		
2GHz to 2.7GHz				
Steps	1%			
	Horizontal	Vertical	Horizontal	Vertical
Front	A	A		
Right	A	A		
Rear	A	A		
Left	A	A		
Test Equipment : 1. Signal Generator : N5181A (Agilent) 2. Power Amplifier : AS0102-55 (MILMEGA) & 80RF1000-175 (MILMEGA) & AS1860-50 (MILMEGA) 3. Log.-Per.Antenna: VULP9118E (SCHWARZBECK) 4. Broad-Band Horn Antenna: STLP 9149 (Schwarzbeck) 5. RF Power Meter. Dual Channel: 4232A (BOONTON) 6. Field Strength Meter: RSS1006A (DARE)				
Note:				


9. ELECTRICAL FAST TRANSIENT/BURST IMMUNITY TEST

9.1. Block Diagram of Test Setup

9.1.1. Block Diagram of EUT System

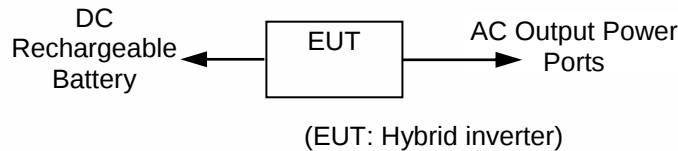

9.1.2. EFT Test Setup

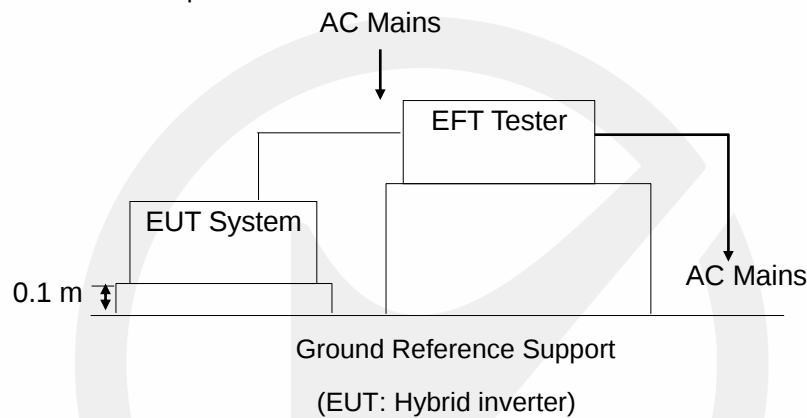

9.2. Test Standard

EN 61000-6-2:2005 (IEC 61000-4-4:2012, Severity Level:
AC Output Power Ports: 2kV)

9.3. Severity Levels and Performance Criterion

9.3.1. Severity level

Open Circuit Output Test Voltage $\pm 10\%$		
Level	On Power Supply Lines	On I/O (Input/Output) Signal data and control lines
1	0.5 kV	0.25 kV
2	1 kV	0.5 kV
3	2 kV	1 kV
4	4 kV	2 kV
X	Special	Special

9.3.2. Performance criterion: B

9.4. Operating Condition of EUT

- 9.4.1. Setup the EUT as shown on Section 9.1.
- 9.4.2. Turn on the power of all equipment.
- 9.4.3. Let the EUT work in test mode (ON) and test it.

9.5. Test Procedure

The EUT is put on the table that is 0.1 meter high above the ground. This reference ground plane shall project beyond the EUT by at least 0.1m on all sides and the minimum distance between EUT and all other conductive structure, except the ground plane beneath the EUT, shall be more than 0.5m.

9.5.1. For input and output AC power ports:

The EUT is connected to the power mains by using a coupling device that couples the EFT interference signal to DC power lines. Both polarities of the test voltage should be applied during compliance test and the duration of the test is 2 mins.

9.5.2. For signal lines and control lines ports:

No I/O ports. It's unnecessary to test.

9.5.3. For DC output line ports:

The AC Output Power Ports of EUT are connected to the AC power mains by using a coupling device that couples the EFT interference signal to AC power lines (AC Output Power Ports). All of the test voltage should be applied during compliance test and the duration of the test is 2 mins.

9.6. Test Results

PASS.

Please refer to the following page.

Electrical Fast Transient/Burst Test Results


EMTEK (SHENZHEN) CO., LTD.

Standard: ☒ EN 61000-4-4		Result: ☐ PASS / ☐ FAIL	
Applicant : <u>Shenzhen Ateess Power Technology Co., Ltd.</u>			
EUT : <u>Hybrid inverter</u>			
M/N : <u>HPS150</u>			
Input Voltage: <u>AC 380V/50Hz</u>			
Criterion : B			
Ambient Condition : <u>22 °C</u> <u>50% RH</u>			
Operation Mode: ON			
Line : ☐ ☒ A C Mains		Line : ☐ ☐ Signal ☐ ☐ I/O Cable	
Coupling : ☒ Direct		Coupling : ☐ ☐ Capacitive	
Test Time : 120s			
Line	Test Voltage	Result(+)	Result(-)
L1, L2, L3, N, PE	2kV	A	A
L1-L2, L1-L3, L2-L3, L1-N, L2-N, L3-N	2kV	A	A
L1-PE, L2-PE, L3-PE, N-PE	2kV	A	A
L1-L2-PE, L1-L3-PE, L2-L3-PE, L1-L2-L3, L1-L2-N, L1-L3-N, L2-L3-N, L1-N-PE, L2-N-PE, L3-N-PE	2kV	A	A
L1-L2-L3-PE, L1-L2-L3-N, L1-L2-N-PE, L1-L3-N-PE, L2-L3-N-PE	2kV	A	A
Signal Line			
DC Line	2kV	A	A
Note:			


10. SURGE IMMUNITY TEST

10.1. Block Diagram of Test Setup

10.1.1. Block Diagram of EUT System

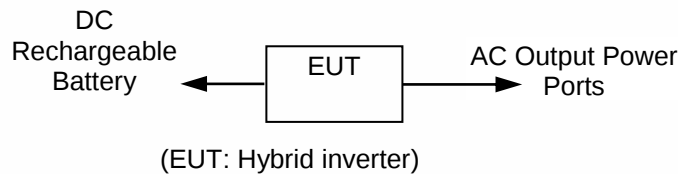

10.1.2. Surge Test Setup

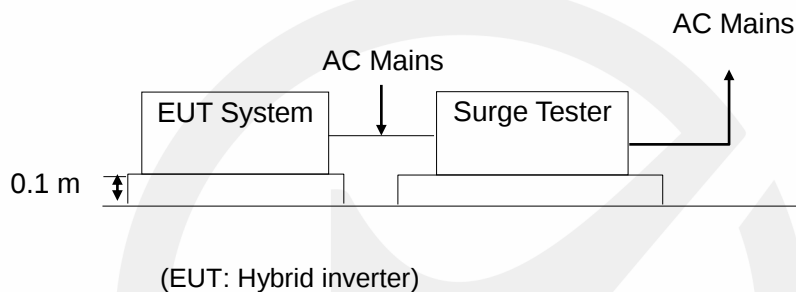

10.2. Test Standard

EN 61000-6-2:2005

(IEC61000-4-5:2014, Severity Level: AC Output Power Ports:

Line to Line: Level 2, 1.0kV; Line to earth, Level 3, 2.0kV, DC Line, Level 1, 0.5kV)

10.3. Severity Levels and Performance Criterion

10.3.1. Severity level

Severity Level	Open-Circuit Test Voltage kV
1	0.5
2	1.0
3	2.0
4	4.0
*	Special

10.3.2. Performance criterion: B

10.4. Operating Condition of EUT

10.4.1. Setup the EUT as shown on Section 10.1.

10.4.2. Turn on the power of all equipment.

10.4.3. Let the EUT work in test mode (ON) and test it.


10.5. Test Procedure

- 1) Set up the EUT and test generator as shown on Section 10.1.2.
- 2) For AC Output Power Ports: For line to line coupling mode, provide a 1.0 kV 1.2/50us voltage surge (at open-circuit condition) and 8/20us current surge to EUT selected points. For line to Earth coupling mode, provide a 2.0 kV 1.2/50us voltage surge (at open-circuit condition) and 8/20us current surge to EUT selected points.1.2/50us voltage surge (at open-circuit condition) and 8/20us current surge to EUT selected points.
For DC line coupling mode, provide a 0.5 kV 1.2/50us voltage surge (at open-circuit condition) and 8/20us current surge to EUT selected points.
- 3) At least 5 positive and 5 negative (polarity) tests with a maximum 1/min repetition rate are conducted during test.
- 4) Different phase angles are done individually.
- 5) Record the EUT operating situation during compliance test and decide the EUT immunity criterion for above each test.

10.6. Test Results

PASS.

Please refer to the following page.

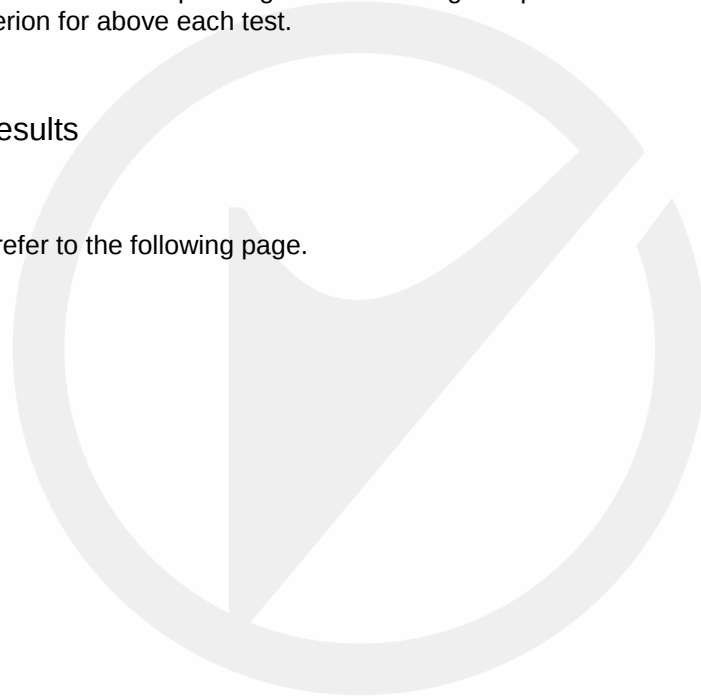

EMTEK (SHENZHEN) CO., LTD.

Criterion : B


[illegible]

Remark:


11. INJECTED CURRENTS SUSCEPTIBILITY TEST

11.1. Block Diagram of Test Setup

11.1.1. Block Diagram of EUT System

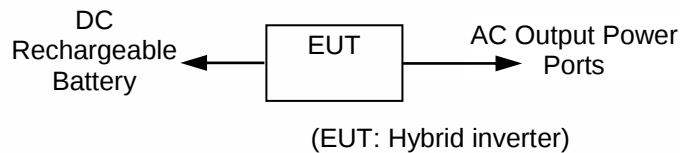

11.1.2. Block Diagram of Test Setup

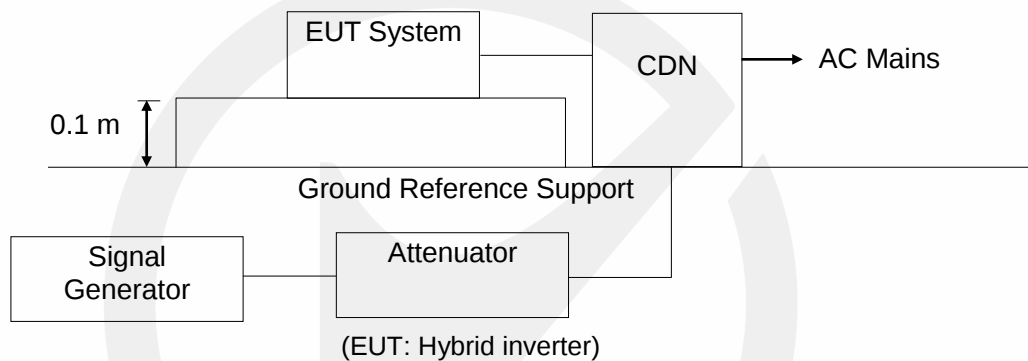

11.2. Test Standard

EN 61000-6-2:2005

(IEC61000-4-6:2013, Severity Level: Level 3, 10V (r.m.s.), 0.15MHz ~ 80MHz)

11.3. Severity Levels and Performance Criterion

11.3.1. Severity level

Level	Field Strength V
1	1
2	3
3	10
X	Special

11.3.2. Performance criterion: A

11.4. Operating Condition of EUT

11.4.1. Setup the EUT as shown on Section 11.1.

11.4.2. Turn on the power of all equipment.

11.4.3. Let the EUT work in test mode (ON) and test it.

11.5. Test Procedure

- 1) Set up the EUT, CDN and test generators as shown on Section 11.1.2.
- 2) Let the EUT work in test mode and measure it.
- 3) The EUT are placed on an insulating support 0.8m high above a ground reference plane. CDN (coupling and decoupling device) is placed on the ground plane about 0.3m from EUT. Cables between CDN and EUT are as short as possible, and their height above the ground reference plane shall be between 30 and 50 mm (where possible).
- 4) The EUT are placed on an insulating support 0.8m high above a ground reference plane. EM-Clamp is placed on the ground plane about 0.3m from EUT.
- 5) The disturbance signal described below is injected to EUT through CDN.
- 6) The EUT operates within its operational mode(s) under intended climatic conditions after power on.
- 7) The frequency range is swept from 150kHz to 80MHz using 10V signal level, and with the disturbance signal 80% amplitude modulated with a 1kHz sine wave.
- 8) The rate of sweep shall not exceed 1.5×10^{-3} decades/s. Where the frequency is swept incrementally, the step size shall not exceed 1% of the start and thereafter 1% of the preceding frequency value.
- 9) Recording the EUT operating situation during compliance testing and decide the EUT immunity criterion.

11.6. Test Results

PASS.

Please refer to the following page.

Injected Currents Susceptibility Test Results

EMTEK (SHENZHEN) CO., LTD.

Applicant : Shenzhen Ateess Power Technology Co., Ltd.EUT : Hybrid inverterTest Date: August 28, 2017M/N : HPS150Temperature : 22°CPower Supply : AC 380VHumidity : 58%Test Engineer : ZCJ

Test Mode: ON

Frequency Range (MHz)	Injected Position	Strength (Unmodulated)	Criterion	Result
0.15 ~ 80	AC Output Power Ports	10V	A	A

Test Mode : N/A

Frequency Range (MHz)	Injected Position	Strength (Unmodulated)	Criterion	Result

Remark : 1. Modulation Signal:1kHz 80% AM

Measurement Equipment :

Simulator: CWS 500 (SWITZERLAND EMTEST)


CDN : ☐ CDN-M2 (SWITZERLAND EMTEST)☒ CDN-M4 (SWITZERLAND EMTEST)☐ EM-Clamp (SWITZERLAND EMTEST)

Note:


12. MAGNETIC FIELD SUSCEPTIBILITY TEST

12.1. Block Diagram of Test Setup

12.1.1. Block diagram of EUT System

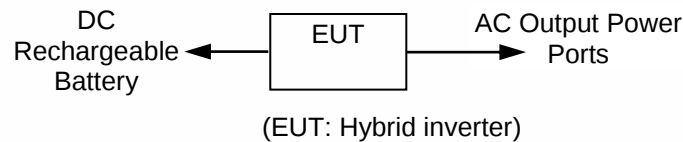

12.1.2. Magnetic field test setup

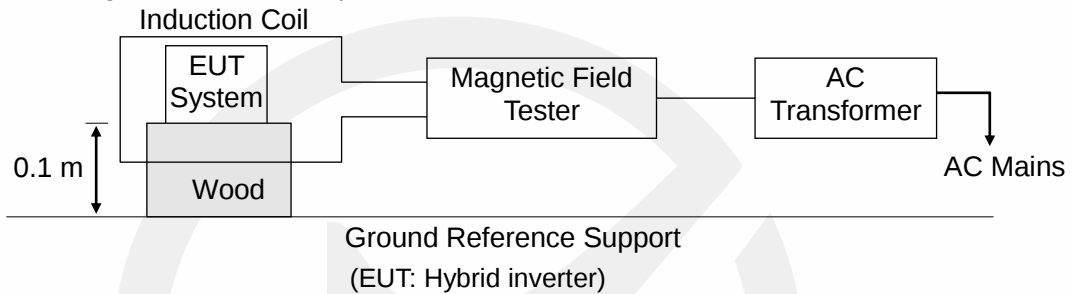

12.2. Test Standard

EN 61000-6-2:2005
(IEC 61000-4-8:2009, Severity Level: Level 4, 30 A/m)

12.3. Severity Levels and Performance Criterion

12.3.1. Severity Levels

Level	Field Strength A/m
1	1
2	3
3	10
4	30
5	100
X	Special

12.3.2. Performance Criterion: A

12.4. Operating Condition of EUT

12.4.1. Setup the EUT as shown on Section 12.1.

12.4.2. Turn on the power of all equipment.

12.4.3. Let the EUT work in test mode (ON) and test it.

12.5. Test Procedure

The EUT is placed in the middle of a induction coil (1*1m), under which is a 1*1*0.1m (high) table, this small table is also placed on a larger table, 0.8 m above the ground. Both horizontal and vertical polarization of the induction coil is set on test, so that each side of the EUT is affected by the magnetic field. Also can reach the same aim by change the position of the EUT.

12.6. Test Results

PASS.

Please refer to the following page.



Magnetic Field Immunity Test Results

EMTEK (SHENZHEN) CO., LTD.

Standard: ☒ EN 61000-4-8		Result: ☒ PASS / ☐ FAIL		
Applicant : <u>Shenzhen Ateess Power Technology Co., Ltd.</u> EUT : <u>Hybrid inverter</u> M/N : <u>HPS150</u> Input Voltage : <u>AC 380V</u> Date of Test : <u>August 28, 2017</u> Test Engineer: <u>ZCJ</u> Ambient Condition : Temp : <u>22°C</u> Humid: <u>55%</u> Criterion: A				
Operation Mode: ON				
Test Level (A/m)	Testing Duration	Coil Orientation	Criterion	Result
30	5 mins	X	A	A
30	5 mins	Y	A	A
30	5 mins	Z	A	A
Operation Mode: N/A				
Test Level (A/m)	Testing Duration	Coil Orientation	Criterion	Result
Test Equipment	Magnetic Field Test: HEAFELY MAG 100.1			
Note:				

13. VOLTAGE DIPS AND INTERRUPTIONS TEST


13.1. Block Diagram of Test Setup

13.1.1. Block Diagram of EUT System



(EUT: Hybrid inverter)

13.1.2. Dips Test Setup

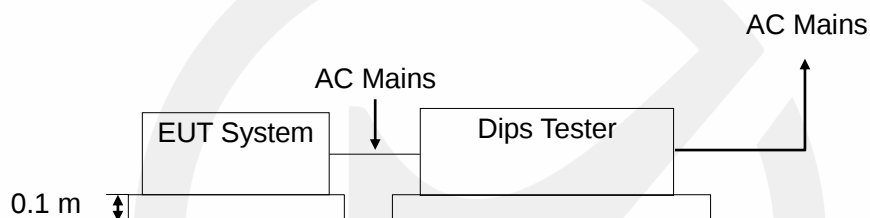

(EUT: Hybrid inverter)

13.2. Test Standard

EN 61000-6-2:2005 (IEC 61000-4-11:2004)

13.3. Severity Levels and Performance Criterion

13.3.1. Severity level

Test Level %UT	Voltage dip and short interruptions %UT	Duration (in period)
0	100	0.5 1 5
40	60	10 25 50
70	30	*

13.3.2. Performance criterion: B&C

13.4. Operating Condition of EUT

- 13.4.1. Setup the EUT as shown on Section 13.1.
- 13.4.2. Turn on the power of all equipment.
- 13.4.3. Let the EUT work in test mode (ON) and test it.


13.5. Test Procedure

- 1) Set up the EUT and test generator as shown on Section 13.1.2.
- 2) The interruption is introduced at selected phase angles with specified duration.
- 3) Record any degradation of performance.

13.6. Test Results

PASS.

Please refer to the following page.

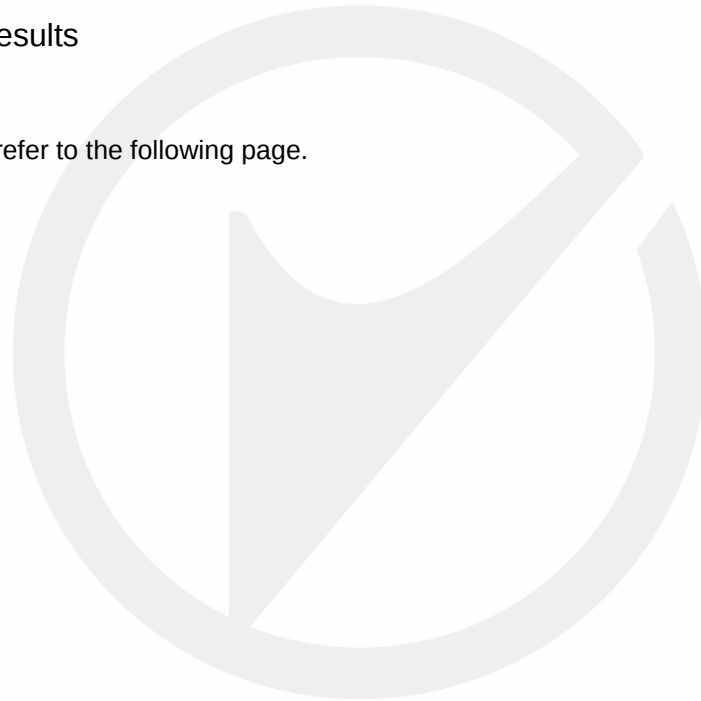

Voltage Dips and Interruptions Test Results

EMTEK(SHENZHEN) CO., LTD.

Applicant : Shenzhen Ateess Power Technology Co., Ltd.

EUT : Hybrid inverter

Test Date : August 28, 2017

M/N : HPS150

Temperature : 24°C

Power Supply : AC 380V / 50Hz

Humidity : 53%

Test Mode: ON

Test Level % U_T	Voltage Dips & Short Interruptions % U_T	Duration (in periods)	Criterion ☐ A ☒ B ☒ C ☐ D	Result
0	100	1P	B	A
40	60	10P	C	A
70	30	25P	C	A
0	100	250P	C	B

Note: Test in 0%, 250P, EUT stop work, but could be recoverable by itself.


14. PHOTOGRAPHS

14.1.Photos of Conducted Emission Measurement



14.2.Photos of Radiation Emission Measurement



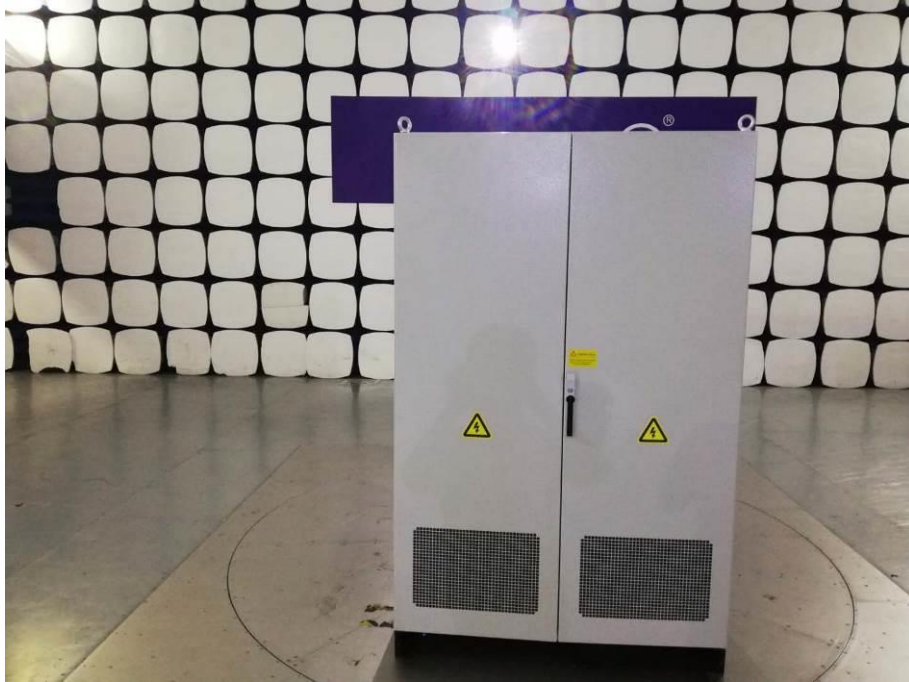

14.3.Photo of Electrostatic Discharge Test



14.4.Photo of RF Field Strength Susceptibility Test



14.5.Photo of Electrical Fast Transient / Burst Immunity Test



14.6.Photo of Surge Test



14.7.For Injected Current Susceptibility Test



14.8.Photo of Magnetic Field Immunity Test




14.9.Photo of Voltage Dips and Interruption Immunity Test










APPENDIX (Photos of EUT)






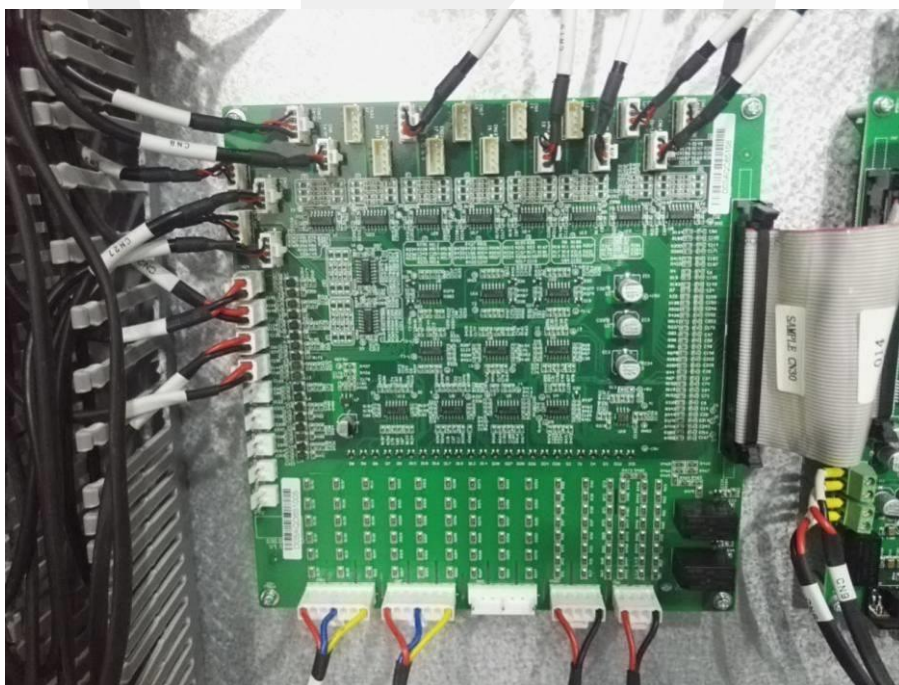


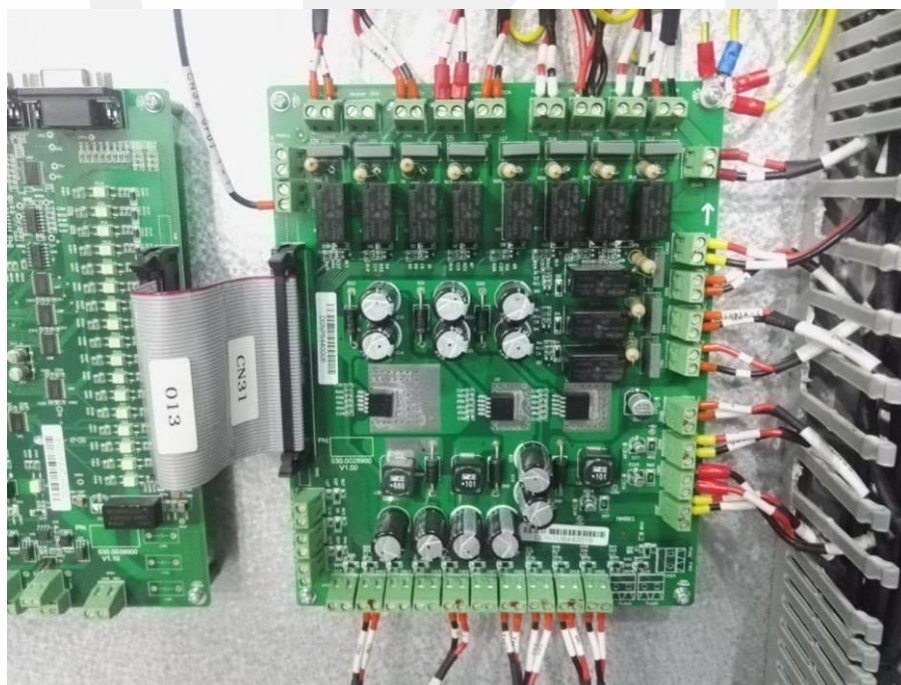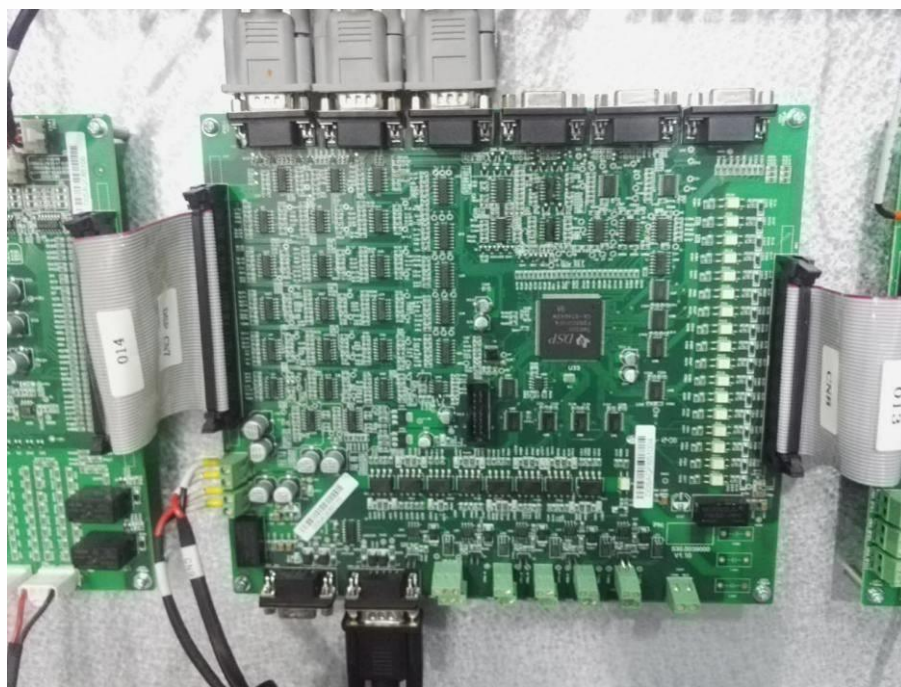


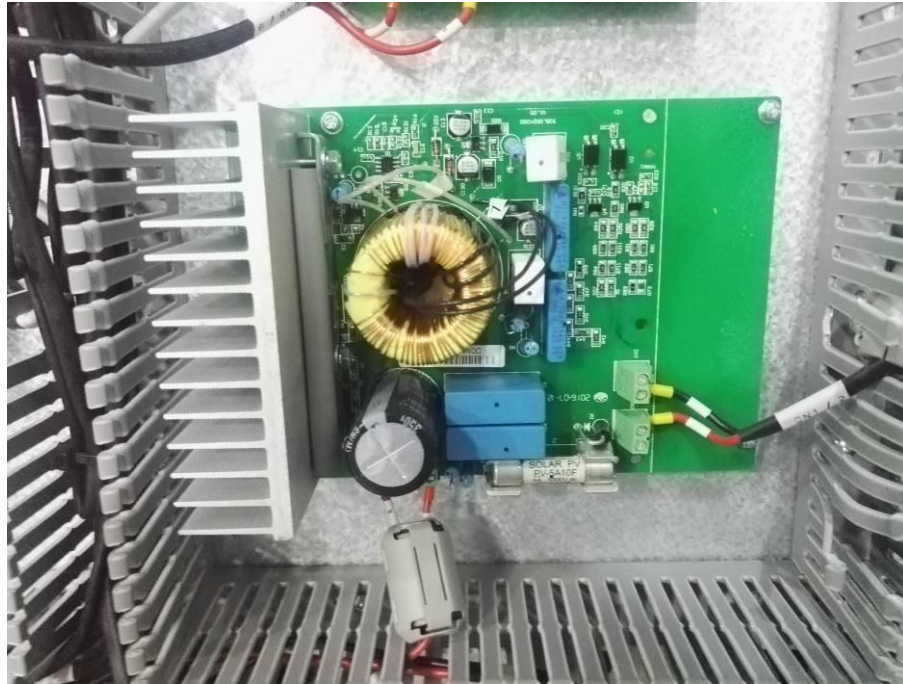

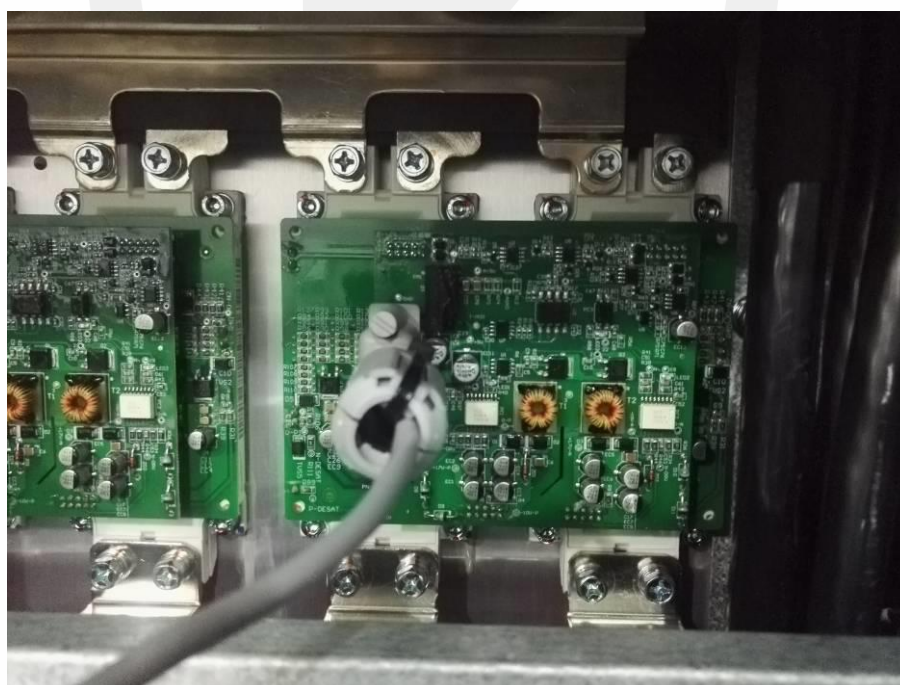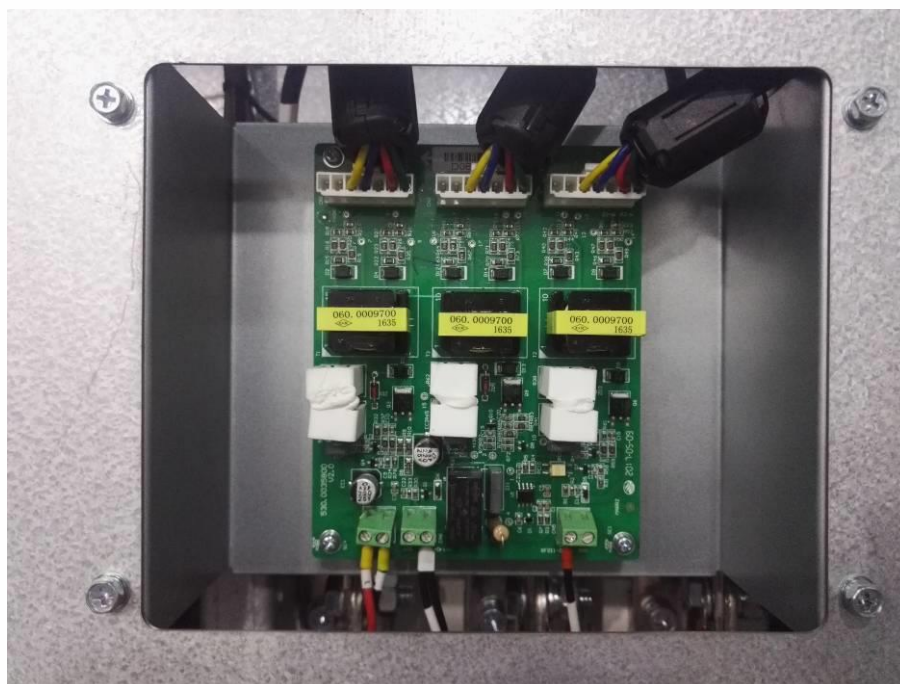


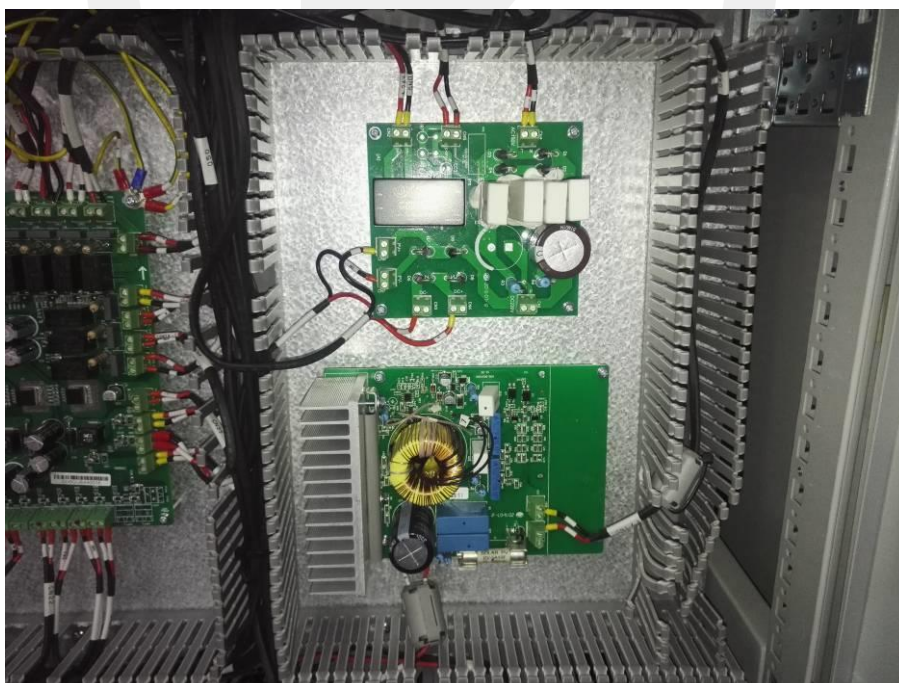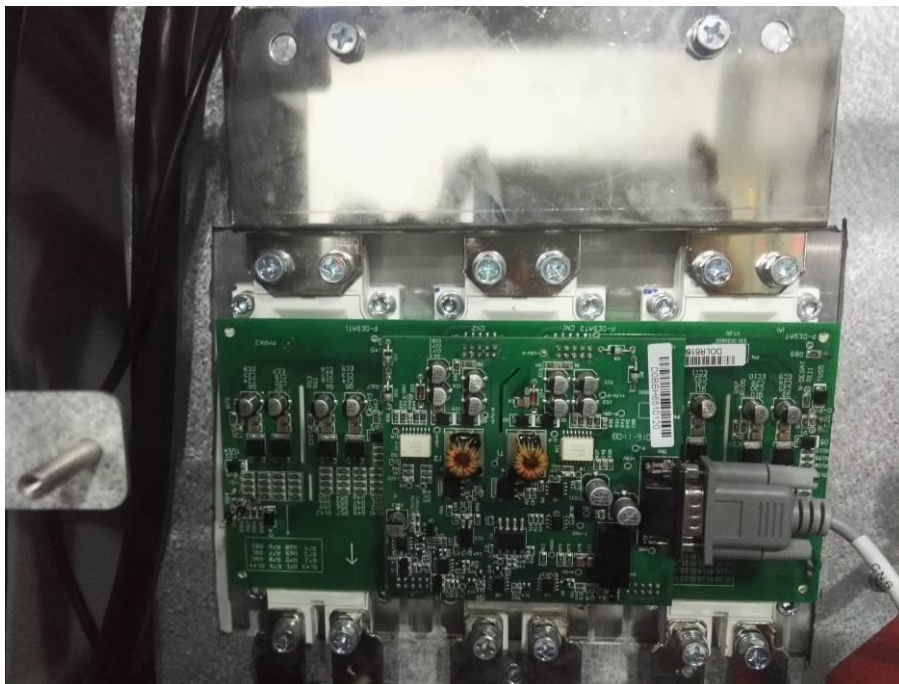

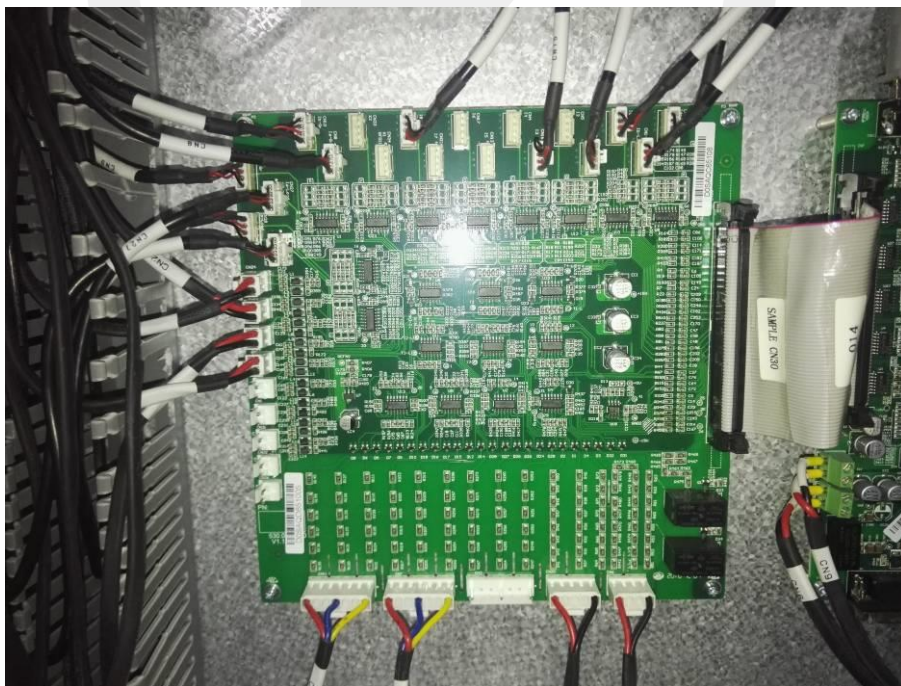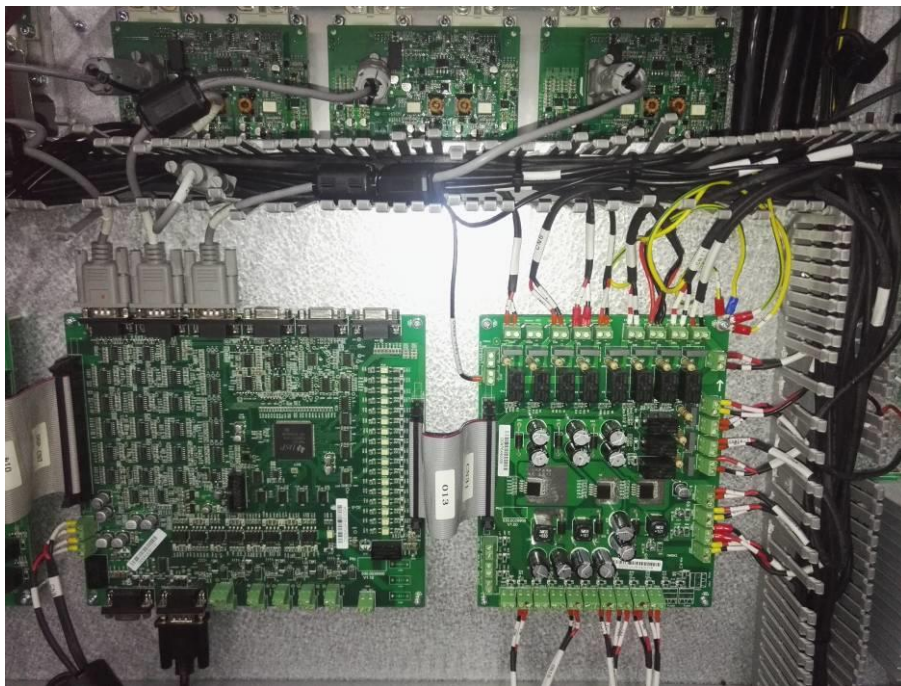


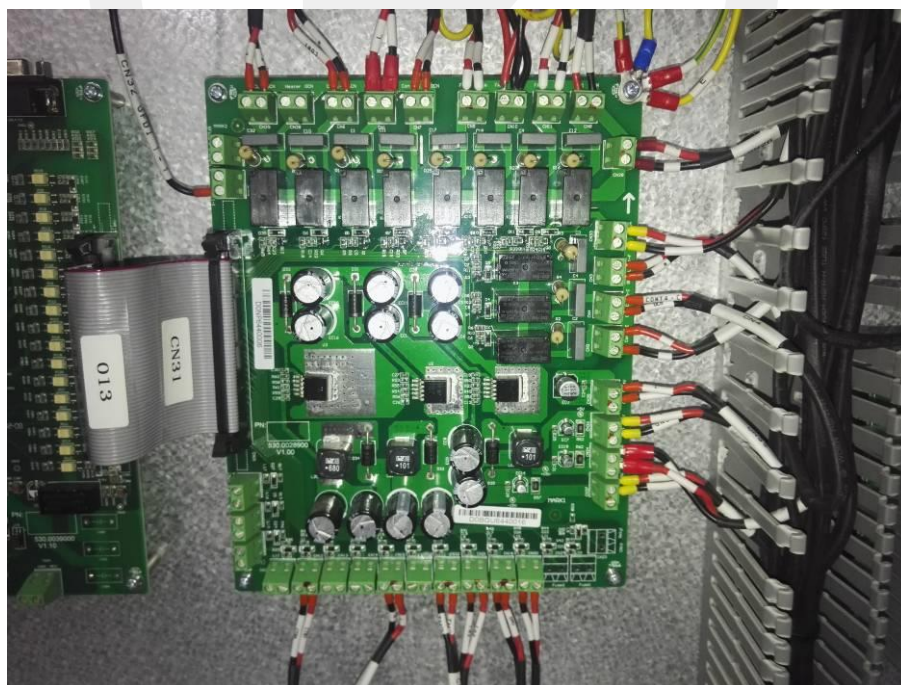



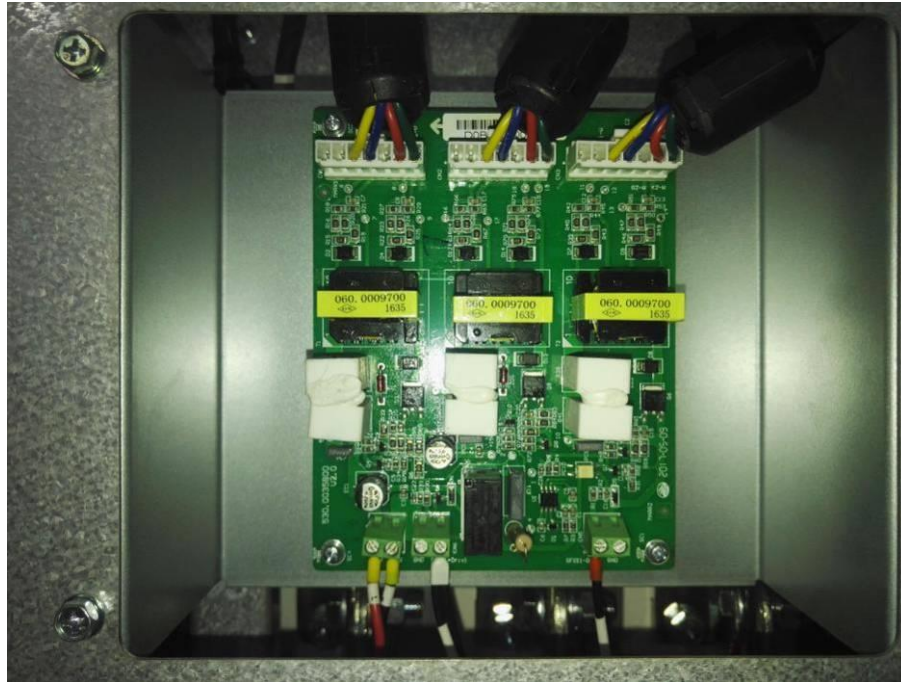



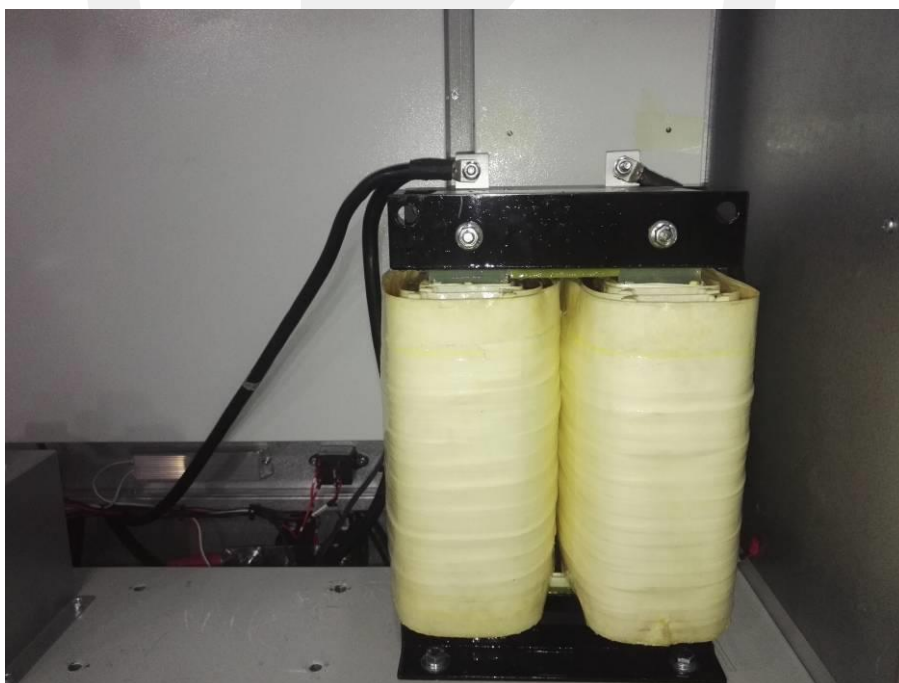

*** End of Report ***